



Special Applications

PILZ
THE SPIRIT OF SAFETY

- ▶ Configurable small control systems PNOZmulti

This document is the original document.

All rights to this documentation are reserved by Pilz GmbH & Co. KG. Copies may be made for the user's internal purposes. Suggestions and comments for improving this documentation will be gratefully received.

Source code from third-party manufacturers or open source software has been used for some components. The relevant licence information is available on the Internet on the Pilz homepage.

Pilz®, PIT®, PMI®, PNOZ®, Primo®, PSEN®, PSS®, PVIS®, SafetyBUS p®, SafetyEYE®, SafetyNET p®, the spirit of safety® are registered and protected trademarks of Pilz GmbH & Co. KG in some countries.



SD means Secure Digital

1	Introduction	5
1.1	Definition of symbols	5
2	Muting	6
2.1	Introduction	6
2.2	Safety	6
2.2.1	Intended use	6
2.2.2	Standards	6
2.2.3	Safety guidelines	7
2.3	Configuration in the PNOZmulti Configurator	8
2.3.1	Functions	8
2.3.2	Input parameters	8
2.3.3	Output parameters	9
2.3.4	Monitoring times	9
2.3.5	Suspension of muting (override)	9
2.3.6	Reset	10
2.3.7	Restarting the muting time	10
2.4	Operating modes	11
2.4.1	Terminology	11
2.4.2	Sequential muting	11
2.4.2.1	Position of the muting sensors	11
2.4.2.2	Switch conditions in sequential mode	12
2.4.2.3	Sequence errors	13
2.4.2.4	Diagnostic word	14
2.4.2.5	Timing diagram (example)	15
2.4.3	Parallel muting	15
2.4.3.1	Position of the muting sensors	15
2.4.3.2	Switch conditions in parallel mode	16
2.4.3.3	Diagnostic word	17
2.4.3.4	Timing diagram (example)	17
2.4.4	Cross muting	18
2.4.4.1	Position of the muting sensors	18
2.4.4.2	Switch conditions in cross mode	19
2.4.4.3	Diagnostic word	20
2.4.4.4	Timing diagram (example)	20
3	Safety Mat/Safe Edge	21
3.1	Introduction	21
3.2	Safety	21
3.2.1	Intended use	21
3.2.2	Safety guidelines	22
3.3	Function description	22
3.4	Configuration in the PNOZmulti Configurator	22
3.4.1	Allocation of test pulses to inputs	23
3.5	Commissioning the safety system	23
3.5.1	Preparing for commissioning	23
3.5.2	Preparing for operation	24
3.6	Operation	25
3.6.1	Diagnostic word	25

3.7	Technical requirements	25
4	Burners	26
4.1	Introduction	26
4.2	Safety	26
4.2.1	Intended use	26
4.3	Configuration in the PNOZmulti Configurator	28
4.3.1	Functions	28
4.3.2	Monitoring functions/settings for the burner cycle	29
4.3.2.1	Combustion air pressure monitoring, activating the combustion air blower, compound controller monitoring	29
4.3.2.2	Ignition	30
4.3.2.3	Flame monitoring	30
4.3.2.4	Compound controller	31
4.3.2.5	Tightness control	31
4.3.2.6	High temperature	32
4.3.2.7	Plant-dependent monitoring functions	32
4.3.2.8	Shutdown types	33
4.3.2.9	Step times	33
4.4	Burner cycle	34
4.4.1	Steps	34
4.4.2	Errors during the burner cycle	35
4.4.3	Master burner with direct ignition	36
4.4.4	Master burner with separate flame monitoring	37
4.4.5	Master burner with joint flame monitoring	38
4.4.6	Slave burner with direct ignition	39
4.4.7	Slave burner with separate flame monitoring	40
4.4.8	Slave burner with joint flame monitoring	41
4.4.9	Example: Viewing the burner cycle in the PNOZmulti Configurator	41
4.5	Inputs and outputs	43
4.5.1	Element's inputs	43
4.5.1.1	Operation	43
4.5.1.2	Monitoring functions	44
4.5.2	Element's outputs	45
4.6	Configuration examples	47
4.6.1	Burner configuration	47
4.6.1.1	Burner structure	47
4.6.1.2	Burner properties	47
4.6.1.3	Configuration in the PNOZmulti Configurator	48
4.6.2	Connecting the safety valves on PNOZmulti Classic systems	49
5	Loop formation (LOOP)	50
5.1	Introduction	50
5.1.1	Intended use	50
5.2	Function description	50
5.3	Example configurations	51
5.3.1	Application using one loop	51
5.3.2	Application using two loops	52

1 Introduction

1.1 Definition of symbols

Information that is particularly important is identified as follows:



DANGER!

This warning must be heeded! It warns of a hazardous situation that poses an immediate threat of serious injury and death and indicates preventive measures that can be taken.



WARNING!

This warning must be heeded! It warns of a hazardous situation that could lead to serious injury and death and indicates preventive measures that can be taken.



CAUTION!

This refers to a hazard that can lead to a less serious or minor injury plus material damage, and also provides information on preventive measures that can be taken.



NOTICE

This describes a situation in which the product or devices could be damaged and also provides information on preventive measures that can be taken. It also highlights areas within the text that are of particular importance.



INFORMATION

This gives advice on applications and provides information on special features.

2 Muting

2.1 Introduction

This chapter describes the muting function with units from the configurable control system PNOZmulti. The safe inputs and outputs from base units and expansion modules are suitable.



NOTICE

With a muting application, please refer to the operating manuals provided with the units. Please also refer to the PNOZmulti technical catalogue.

2.2 Safety

2.2.1 Intended use

The muting logic element is used to temporarily suspend safety functions (ESPE/AOPD) without interrupting the process (muting) in accordance with EN 61496-1. For a limited time period and a specific operational phase (e.g. when feeding materials), it will suspend the effect of safety devices during the working process. Once completed, it will reset the safety function.

Use of this operating mode and the arrangement of the sensors are machine or plant-specific and depend on the risk assessment of the machine or plant.

Be sure that you observe the warning notes given in the other parts of this configuration guide and in the PNOZmulti technical catalogue. These are highlighted visually through the use of symbols.



CAUTION!

Failure to observe the safety regulations in this configuration guide and in the PNOZmulti technical catalogue will render the warranty invalid.

2.2.2 Standards

Knowledge of and compliance with the relevant standards and directives are a prerequisite for using the muting function. The following gives an overview of the most important standards:

- ▶ EN 61496-1: Safety of machinery – Electrosensitive protective equipment
- ▶ EN 60947-5-3: Low voltage switchgear and controlgear - Control circuit devices and switching elements
- ▶ EN 999: Safety of machinery - The positioning of protective equipment

Please note this is not an exhaustive list of safety standards and directives.

2.2.3 Safety guidelines

**WARNING!**

The following information must be heeded! Failure to comply with these guidelines could result in **serious injury or death**.

- ▶ Refer to EN 61496-1 and EN 60947-5-3 when configuring, setting up and operating the muting device.
- ▶ Refer to EN 999 with regard to the positioning of the AOPD.
- ▶ Measures must be taken to exclude common cause failures, e.g. by the use of non-equivalent signals or diverse sensors.
- ▶ Muting switches should be positioned so that it is impossible for a person to trigger the muting function.
- ▶ The vehicle should be designed to make it impossible for people to ride on it.
- ▶ Limit the size of the entry area by applying appropriate safety measures. People must not be able to enter the danger zone during the muting phase.
- ▶ If various transport speeds are being used, consider the total duration of the muting phase.
- ▶ Remember that a new muting phase can only be introduced once the previous phase has been completed.
- ▶ Maintenance gates should be provided if you secure equipment through muting.
- ▶ Please note that if the maintenance gates are opened, the plant **absolutely must** be brought to a standstill in accordance with the risk classification.
- ▶ Use of muting sensors with contacts: Supply the contacts of the muting sensors via test pulse outputs (test pulses).
- ▶ Use of ESPE as muting sensors: Test pulses cannot be used. For this reason, be sure to use a N/O contact as sensor 1 and a N/C contact as sensor 2 for fault detection (shorts across contacts).
- ▶ Laying the connection cable to the sensors in a way that is protected against shorts (i.e. separate) may provide an alternative to non-equivalent sensors.

2.3 Configuration in the PNOZmulti Configurator

2.3.1 Functions

- ▶ Muting via light beam devices or limit switches
- ▶ Override option in case of fault
- ▶ Max. muting time can be set
- ▶ Muting sensors can be monitored for simultaneity
- ▶ Configuration of bounce time for contact-based muting sensors
- ▶ Sequence of the muting sensors can be monitored
- ▶ Operating modes
 - Sequential muting
 - Parallel muting
 - Cross muting

2.3.2 Input parameters

- ▶ Muting sensor 1
 - N/O contact of muting sensor 1
 - Muting sensor 1 = 0: Not operated
 - Muting sensor 1 = 1: Operated
- ▶ Muting sensor 2
 - N/O contact of muting sensor 2
 - Muting sensor 2 = 0: Not operated
 - Muting sensor 2 = 1: Operated
- ▶ Light curtain
 - Light curtain = 0: Interrupted
 - Light curtain = 1: Not interrupted
 - Assign the light curtain input parameter to the output of the light curtain function element.
 - The light curtain function element must be configured with an automatic reset.
- ▶ Muting sensor 3
 - N/O contact of muting sensor 3
 - Muting sensor 3 = 0: Not operated
 - Muting sensor 3 = 1: Operated
- ▶ Muting sensor 4
 - N/O contact of muting sensor 4
 - Muting sensor 4 = 0: Not operated
 - Muting sensor 4 = 1: Operated
- ▶ Muting override
 - Muting override = 1: Suspend the muting function if a fault occurs (override) to override the muting channel.
- ▶ Reset = 0/1 pulse edge: Reset muting after an error or start the muting time.

2.3.3 Output parameters

- ▶ Enable
 - Enable = 0: Error detected (e.g. simultaneity exceeded)
 - Enable = 1: The enable is granted if no error has been detected.
- ▶ Muting active
 - Display of muting status (e.g. for activating a lamp)
 - Muting active = 0: No muting (light curtain not suspended)
 - Muting active = 1: Muting active (light curtain suspended)

2.3.4 Monitoring times

- ▶ Maximum muting time
 - This setting is used to adjust the maximum permitted muting time.
 - Permitted value range: 1 ... 900s (= 15 minutes)
- ▶ Simultaneity
 - This setting is used to define the maximum time (synchronisation time) which is permitted to elapse between the actuation (0/1-pulse edge) of muting sensors 1 and 2 or muting sensors 3 and 4.
 - Permissible value range for parallel muting and cross muting: 1 ... 3 s
 - Permitted value range for sequential muting: 1 ... 30 s
- ▶ Bounce time
 - This setting can be used to set the time up to the point at which the muting sensors finally make contact.
 - Permitted value range: 50 ..0.800 ms

2.3.5 Suspension of muting (override)

If there are faults, the muting station can be overridden via the muting override input parameter.

- ▶ **Start-up condition**
 - Muting override can be switched on if at least one of the muting sensors is active. The enable output and *muting active* output parameter are set during the override. The override is monitored and has a maximum duration that corresponds to the set muting time.
- ▶ **Switch-off condition**
 - Muting override is switched off if
 - the muting time has elapsedor
 - no muting sensor is active and the light curtain is clearor
 - muting override is reset to 0 (release override button).



CAUTION!

The following additional safety requirements apply to the muting override:

- The override switch must be fitted with an automatic reset/restart (hold-to-run switch).
- The override switch must be installed in a fixed position outside the danger zone.
- The danger zone and the muting station must be visible from the override switch position.
- The danger zone must be identified as clear before the override switch is operated and while it is operated.

2.3.6

Reset

Reset resets the muting element after a fault or during start-up if

- ▶ no muting sensor is operated
and
- ▶ the light curtain is clear.



CAUTION!

The following additional safety requirements apply for the reset button:

- The danger zone and the muting station must be visible from the reset button position.
- The reset button may not be operated until the danger zone has been viewed and has been identified as clear.

2.3.7

Restarting the muting time

Reset resumes muting and restarts the muting time if

- ▶ muting was ended as a result of the muting time having elapsed (e.g. by the conveyor feed stopping)
and
- ▶ the muting sensors are returning feasible signals and the light curtain has not been interrupted.

2.4 Operating modes

The following operating modes can be implemented:

- ▶ Sequential muting
- ▶ Parallel muting
- ▶ Cross muting



WARNING!

"During muting safe conditions shall be provided by other means" (EN 954-1). For example, this may be achieved by the conveyed item blocking access to the danger zone. Even openings in or between the individual parts of the conveyor flow must never enable access.

2.4.1 Terminology

▶ Muting On

"Muting On" is the switch condition for switching on the muting function. When muting is switched on, the *Muting active* output parameter has a 1 signal and time monitoring runs.

▶ Muting Off

"Muting Off" is the switch condition for ending the muting function. When the muting function is ended, output parameter *Muting active* has a 0 signal.




INFORMATION

You will find important additional information on the use of sensors or contacts in the section entitled "Safety".

2.4.2 Sequential muting

2.4.2.1 Position of the muting sensors

- ▶ The distance between the muting sensors MS1 and MS2 / MS3 and MS4 should be as large as possible.
- ▶ Vehicle length W must be greater than the distance between MS1 and MS3 or MS2 and MS4 ($W > A$ and $W > B$).
- ▶ MS2 and MS3 must be positioned as close as possible in front of/behind the AOPD.

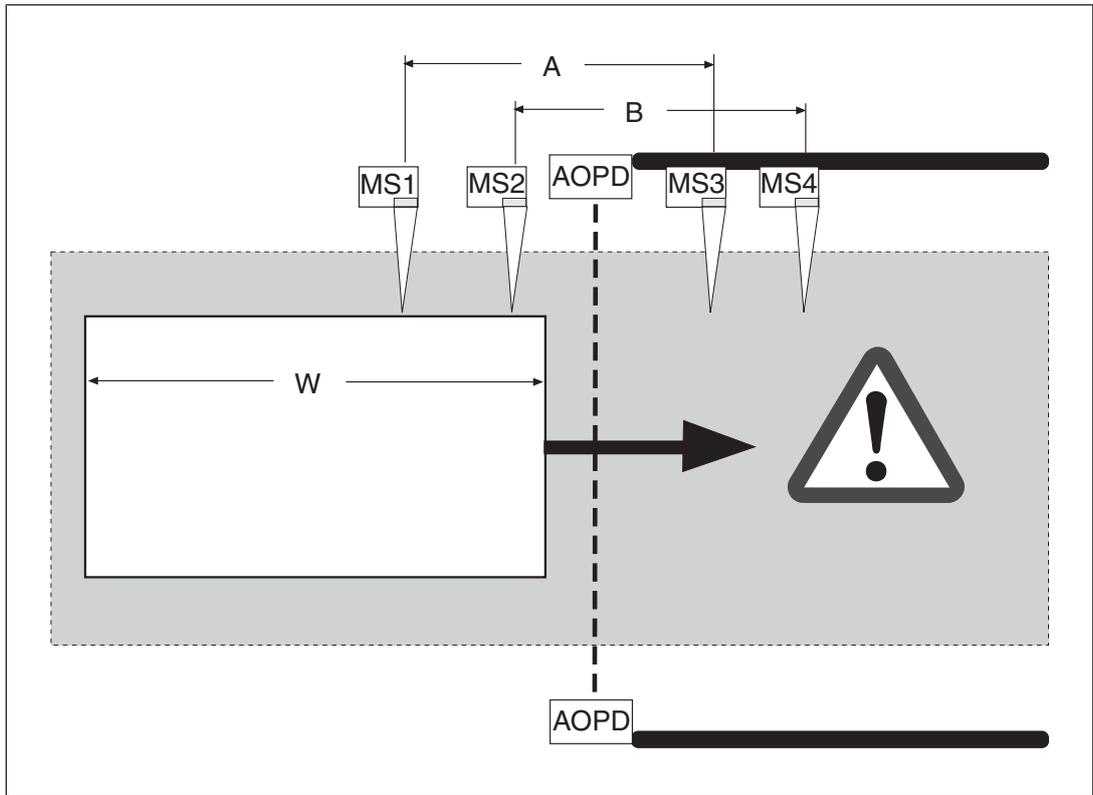

2.4.2.2 Switch conditions in sequential mode

Muting On

Entering the danger zone:

1. Muting sensors MS1 and MS2 must be operated consecutively (first MS1, then MS2) within the configured simultaneity period. Muting is activated by operating MS2.
2. Muting sensors MS3 and MS4 must be operated consecutively (first MS3, then MS4) within the configured simultaneity period.
3. MS1 and MS2 must be cleared consecutively (first MS1, then MS2).
4. MS3 and MS4 must be cleared consecutively (first MS3, then MS4).

Leaving the danger zone:

1. Muting sensors MS4 and MS3 must be operated consecutively (first MS4, then MS3) within the configured simultaneity period. Muting is activated by operating MS3.
2. MS2 and MS1 must be operated consecutively (first MS2, then MS1).
3. MS4 and MS3 must be cleared consecutively (first MS4, then MS3).
4. MS2 and MS1 must be cleared consecutively (first MS2, then MS1).

Muting Off


Suspension of the safety function is cancelled as soon as the penultimate muting sensor, MS2 or MS3, is no longer operated, i.e. only one muting sensor remains operated.

2.4.2.3 Sequence errors

The muting sensors must be operated in a specific sequence in sequential mode. Once a particular directional movement has started (entry or exit), it must be fully completed. Any deviation from the sequence shown causes the enable output (enable = 0) and the output parameter *Muting active* to reset.


Vehicle length W greater than distance C between MS1 and MS4

All sensors are temporarily operated as the vehicle passes through. The first muting sensor (MS1 upon entering, MS4 upon exiting) only becomes clear once all muting sensors have been operated.

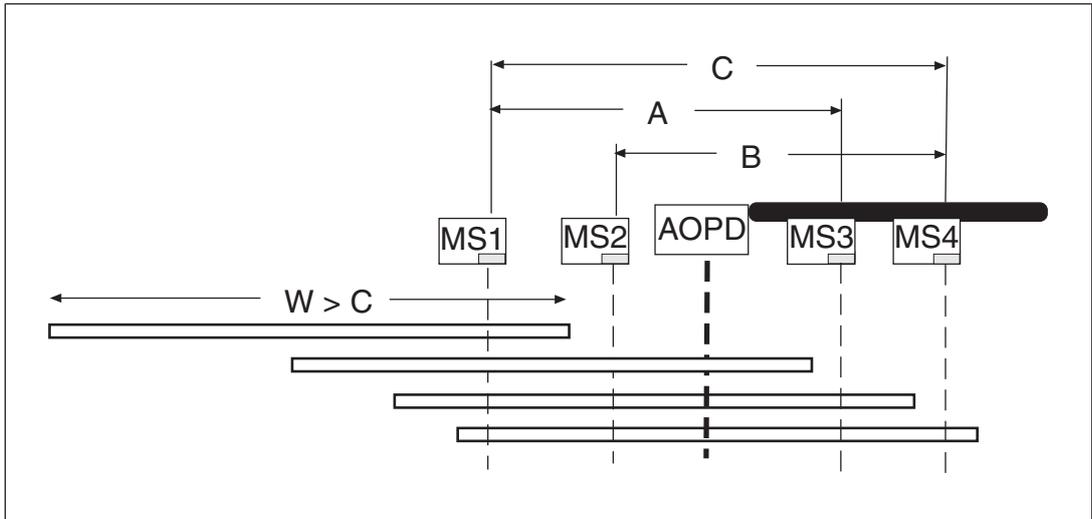

Vehicle length W less than distance C between MS1 and MS4

As the vehicle passes through, the first muting sensor becomes clear (MS1 upon entering, MS4 upon exiting) before the last muting sensor has been operated.

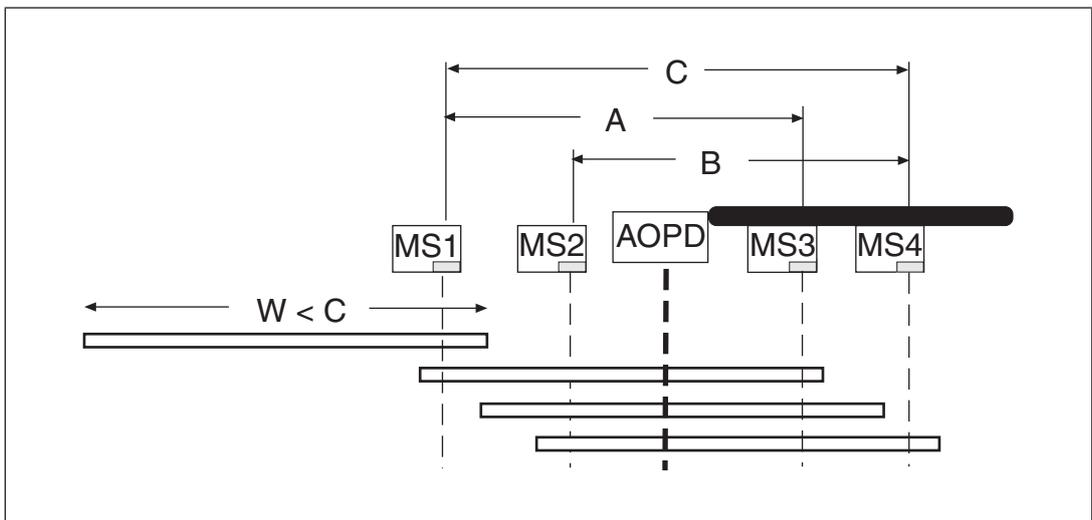

MS1	MS2	MS3	MS4	Travel direction	
0	0	0	0		
1	0	0	0		
1	1	0	0		
1	1	1	0		
1/0	1	1	1/0		
0	1	1	1		
0	0	1	1		
0	0	0	1		
0	0	0	0		

2.4.2.4


Diagnostic word

Messages can be queried in the PNOZmulti Configurator in bit mode and linked further within the program.

- ▶ Bit 1: Light curtain, interrupted (without active muting)
- ▶ Bit 2: Waiting for reset/restart (Reset)
- ▶ Bit 3: Sensor status unfeasible, override required
- ▶ Bit 8: Muting time exceeded
- ▶ Bit 9: Feasibility error, simultaneity period exceeded on muting sensors 1 and 2, only one sensor operated
- ▶ Bit 10: Feasibility error, simultaneity period exceeded on muting sensors 3 and 4, only one sensor operated

2.4.2.5 Timing diagram (example)

Vehicle length W less than distance C between MS1 and MS4

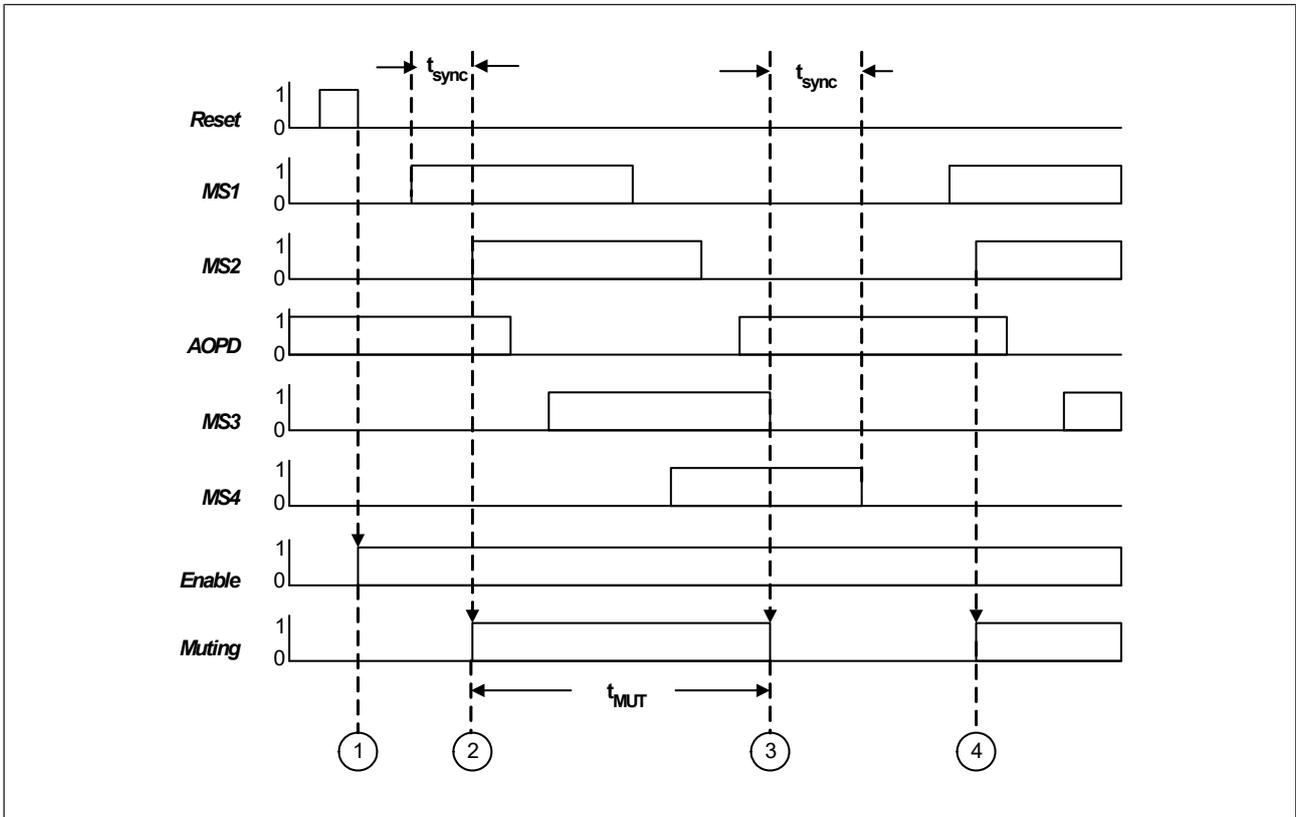

Key:

t_{sync} = Simultaneity

t_{MUT} = Muting time

①: Set enable with reset

②: Start muting via MS1/MS2


③: End muting by clearing MS3

④: Restart muting via MS1/MS2

2.4.3 Parallel muting

2.4.3.1 Position of the muting sensors

- ▶ Muting sensors MS1 and MS2/MS3 and MS4 must be positioned at the same height to the left and right of the vehicle.
- ▶ The vehicle length W must be greater than distance A between MS1 and MS3/MS2 and MS4.
- ▶ The distance between the light curtain and the muting sensor must be as short as possible.

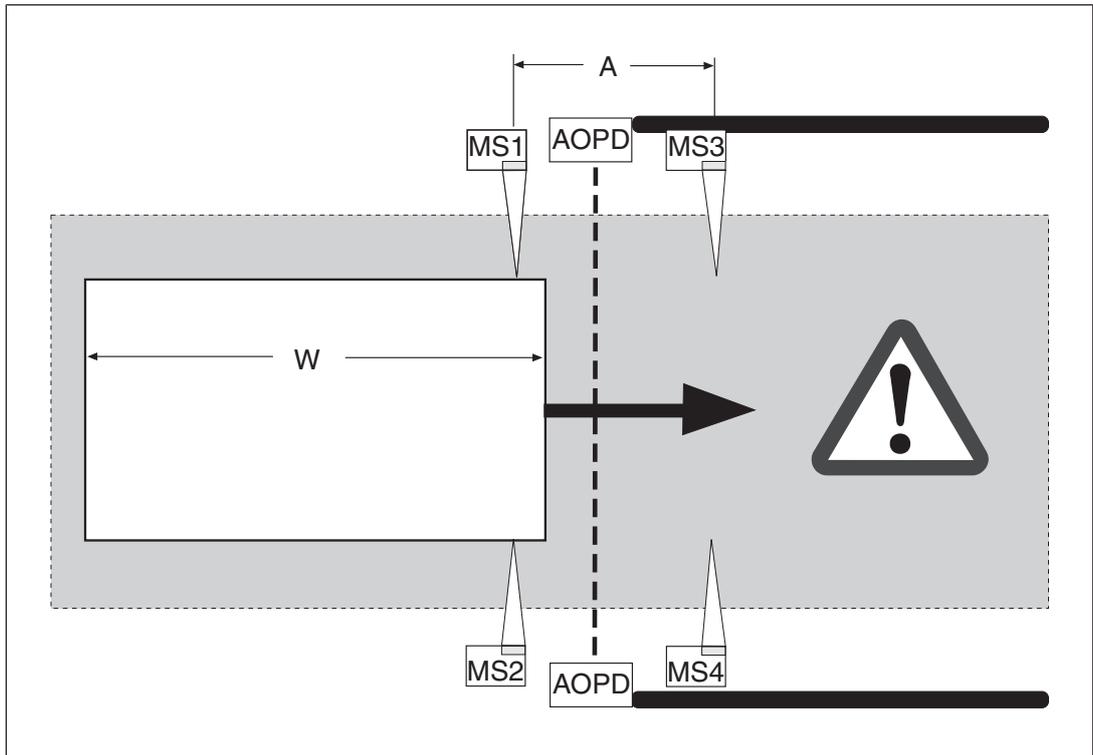

2.4.3.2 Switch conditions in parallel mode

Muting On

Entering the danger zone:

1. Muting sensors MS1 and MS2 must be operated within the configured simultaneity period. Muting is activated.
2. Muting sensors MS3 and MS4 must be operated within the configured simultaneity period, before MS1 and MS2 are cleared.

Leaving the danger zone:

1. Muting sensors MS3 and MS4 must be operated within the configured simultaneity period. Muting is activated.
2. Muting sensors MS1 and MS2 must be operated before MS3 and MS4 are cleared.

Muting Off


Suspension of the safety function is cancelled as soon as the penultimate muting sensor, MS3/MS4 upon entering or MS1/MS2 upon exiting, is no longer operated. In other words, only one muting sensor remains operated.

2.4.3.3 Diagnostic word

Messages can be queried in the PNOZmulti Configurator in bit mode and linked further within the program.

- ▶ Bit 1: Light curtain, interrupted (without active muting)
- ▶ Bit 2: Waiting for reset/restart (Reset)
- ▶ Bit 3: Sensor status unfeasible, override required
- ▶ Bit 8: Muting time exceeded
- ▶ Bit 9: Feasibility error, simultaneity period exceeded on muting sensors 1 and 2, only one sensor operated
- ▶ Bit 10: Feasibility error, simultaneity period exceeded on muting sensors 3 and 4, only one sensor operated

2.4.3.4 Timing diagram (example)

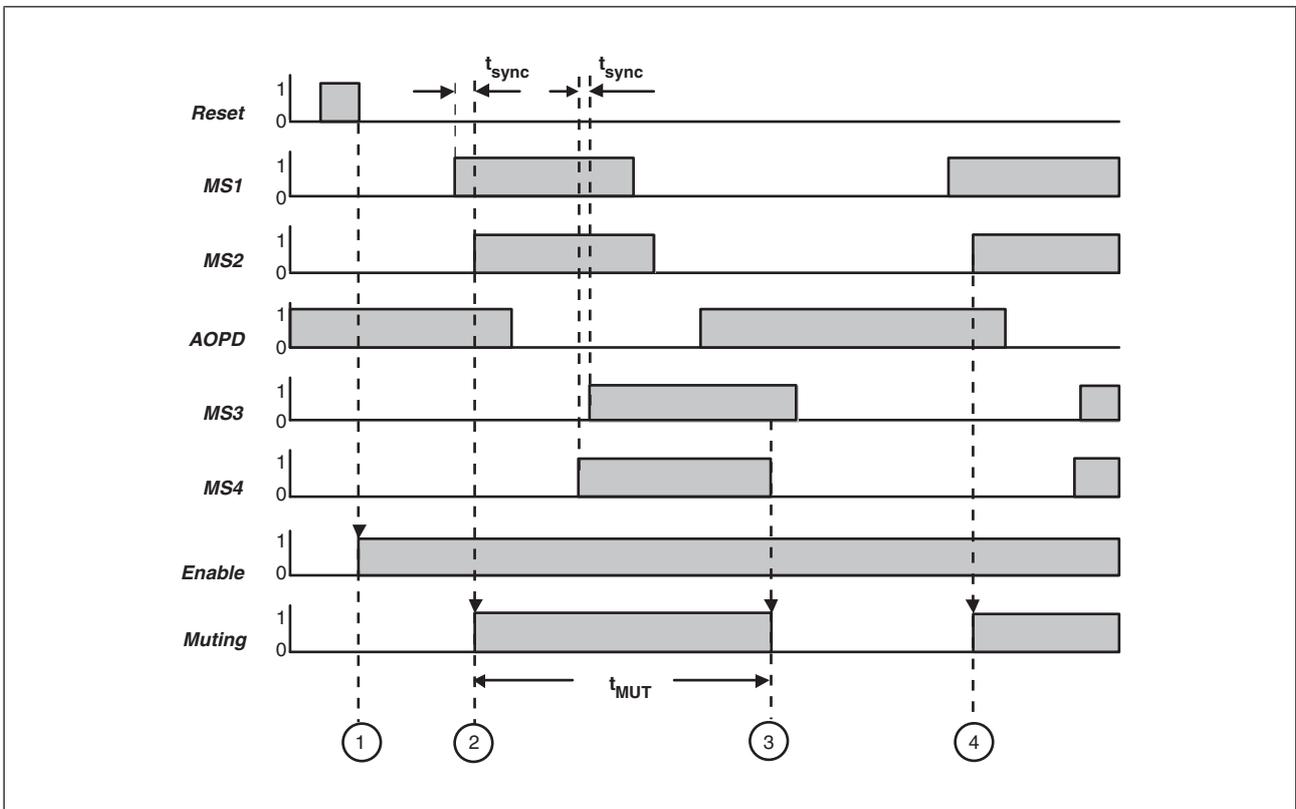

Key:

t_{sync} = Simultaneity

t_{MUT} = Muting time

①: Set enable with reset

②: Start muting via MS1/MS2


③: End muting by clearing MS3 or MS4

④: Restart muting via MS1/MS2

2.4.4 Cross muting

2.4.4.1 Position of the muting sensors

- ▶ Muting sensors may be reflective or send/receive light beam devices, for example. The beams must always intersect within the danger zone.
- ▶ The muting sensors must be positioned in such a way that the light curtain is interrupted before the beam intersection can be reached from outside the danger zone.
- ▶ Muting sensors MS3 and MS4 are not used.

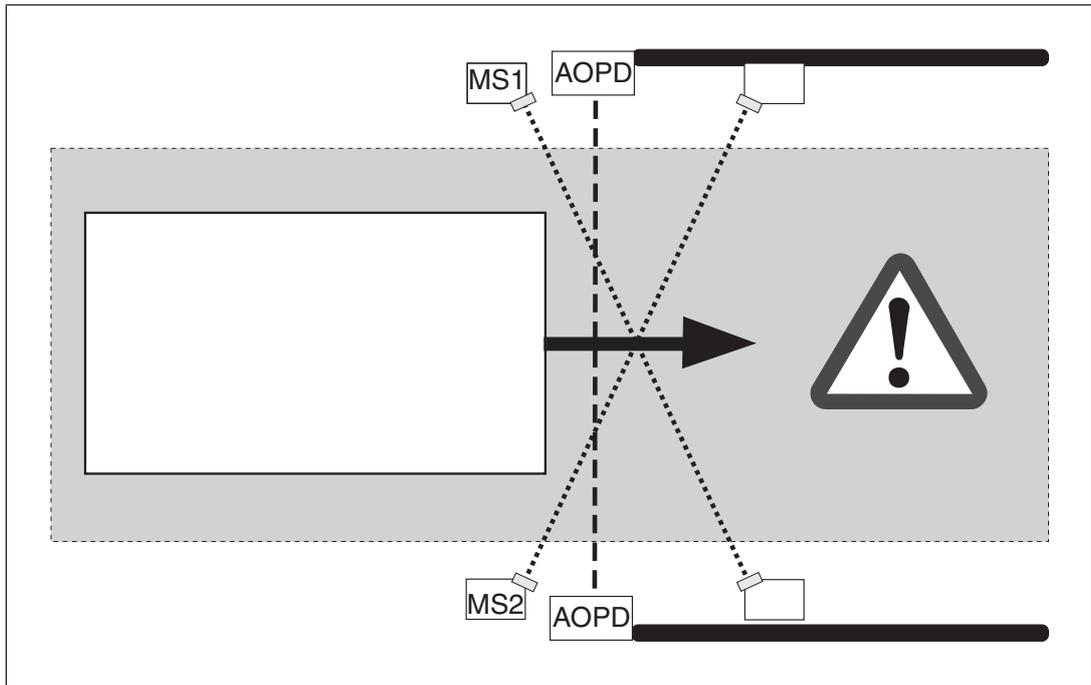

WARNING!

Loss of safety function due to incorrect position of muting sensors

Depending on the application, serious injury or death may result.

Ensure that you comply with the installation dimensions shown in the figure overleaf.

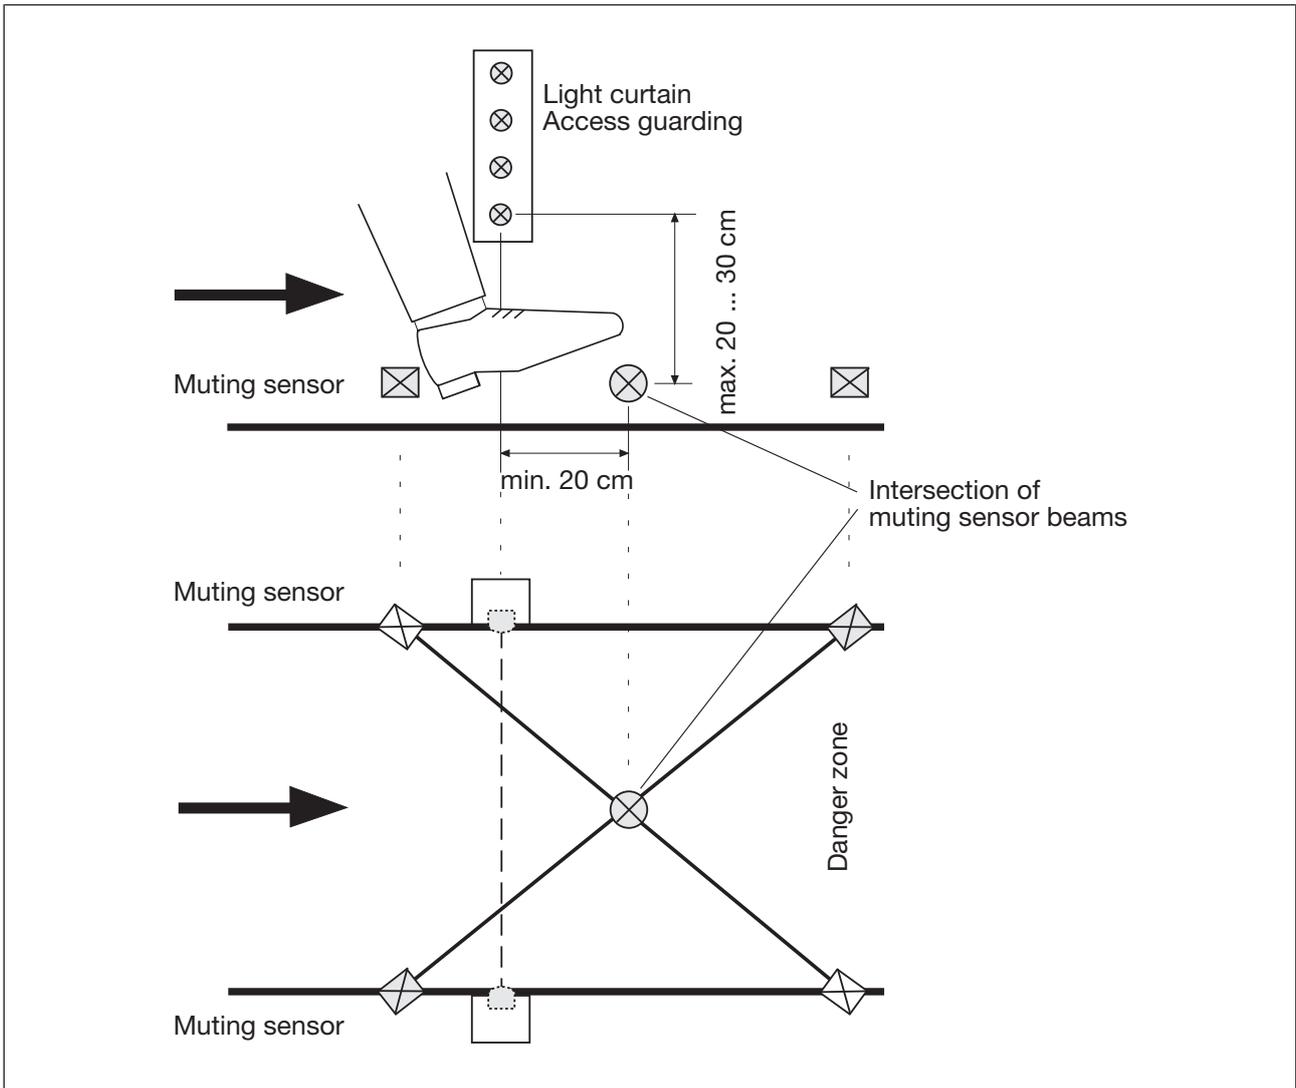


Fig.: Position of the muting sensors (side view and plan view)

2.4.4.2 Switch conditions in cross mode

Muting On

Muting sensors MS1 and MS2 must be operated within the configured simultaneity period.

Muting Off


The suspension of the safety function is lifted when one muting sensor at most is still operated.

2.4.4.3 Diagnostic word

Messages can be queried in the PNOZmulti Configurator in bit mode and linked further within the program.

- ▶ Bit 1: Light curtain, interrupted (without active muting)
- ▶ Bit 2: Waiting for reset/restart (Reset)
- ▶ Bit 3: Sensor status unfeasible, override required
- ▶ Bit 8: Muting time exceeded
- ▶ Bit 9: Feasibility error, simultaneity period exceeded on muting sensors 1 and 2, only one sensor operated

2.4.4.4 Timing diagram (example)

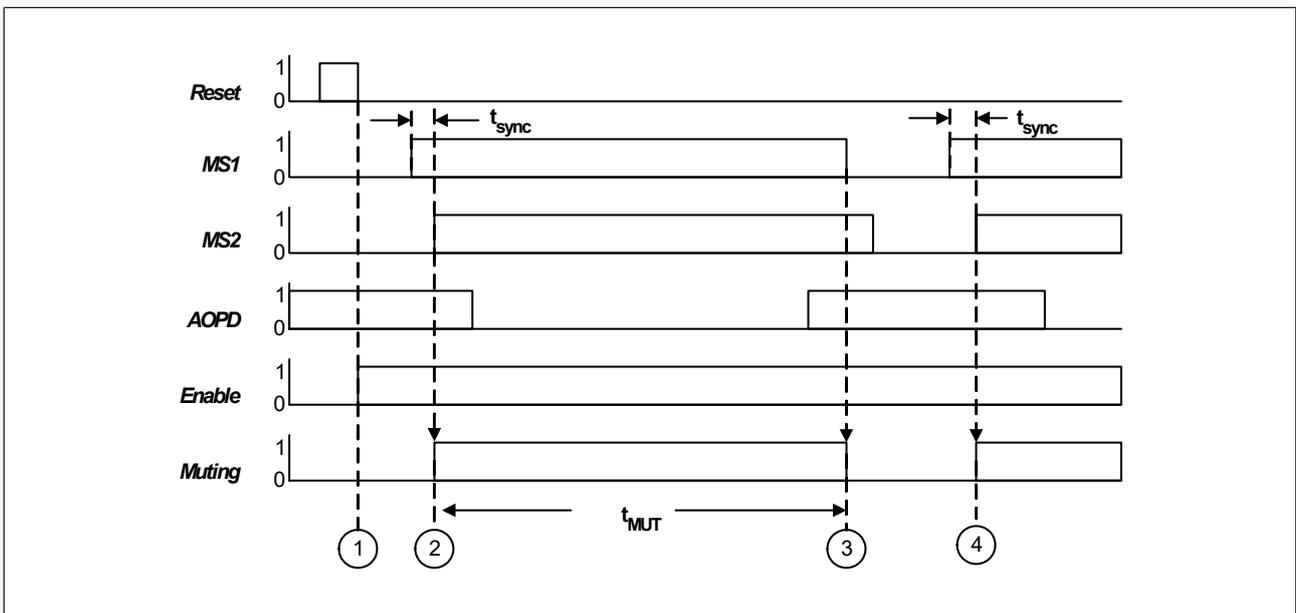

Key:

t_{sync} = Simultaneity

t_{MUT} = Muting time

- ①: Set enable with reset
- ②: Start muting via MS1/MS2
- ③: End muting by clearing MS1 or MS2
- ④: Restart muting via MS1/MS2

3 Safety Mat/Safe Edge

3.1 Introduction

This chapter describes the use of pressure-sensitive protective devices (safety mats and safe edges) with the PNOZmulti.

You must also refer to

- ▶ The operating manuals provided with the PNOZmulti units
- ▶ The PNOZmulti technical catalogue
- ▶ The TÜV certificate for the respective product range (PNOZmulti or PNOZmulti 2)
- ▶ The installation manual and user information provided by the safety mat/safe edge manufacturer (see "Intended use").

Safety mat

A safety mat is a protective device which detects a person standing on it or stepping on to it. The safety mat comprises a sensor which responds to the application of pressure, a control unit and an output signal switching device.

With a safety mat, the effective sensing area is deformed locally when the sensor is operated.

Safe edge

A safe edge is a protective device which is designed to detect contact from a person or any part of a person's body. It comprises:

- ▶ A sensor, which generates a signal when pressure is applied to part of its surface, whereby:
 - Its length is greater than its width
 - Its cross section is constant across its length
 - Cross-sectional width is greater than 8 mm
 - The effective sensing area is deformed locally to actuate the sensor
- ▶ A control unit that responds to a signal from the sensor and generates an output signal that it sends to the machine control system.

3.2 Safety

3.2.1 Intended use

Approved units from the PNOZmulti systems are suitable for connecting pressure-sensitive protective devices (see TÜV certificate for the respective product range PNOZmulti or PNOZmulti 2).

- ▶ The units may only be used as a safety system in conjunction with the approved pressure-sensitive protective devices (see TÜV certificate for the respective product range PNOZmulti or PNOZmulti 2).
- ▶ The pressure-sensitive protective devices must be connected to the inputs on the PNOZmulti units via the PSEN im1 interface or type 1N4007 diodes (see "Commissioning the safety system").

- ▶ Only pressure-sensitive protective devices without installed terminating resistors are suitable.
- ▶ The following are not permitted: Walking aids such as canes and wheeled vehicles
- ▶ The configurable control system PNOZmulti is used for signal processing and as a shut-down device in accordance with EN 13856-1.



CAUTION!

When pressure-sensitive protective devices are connected to PNOZmulti units, the units (including the coated version) may only be operated at an ambient temperature of 0 ... +60 °C.

3.2.2 Safety guidelines

Do not install and commission the safety system until you have read and understood this chapter, the technical catalogue and the installation manual from the safety mat/safe edge manufacturer.

You must also be familiar with the applicable regulations for health and safety at work and accident prevention.

- ▶ In particular you should refer to EN 13856-1 and EN 13856-2.
- ▶ In terms of faults the safety system complies with Category 3, PL d of EN ISO 1349-1 and SIL CL 2 of EN IEC 62061. With the safety mat it's important to consider Note 3 to Clause 4.15 of EN 13856-1
- ▶ The categories for safety mats on machines in accordance with EN 13849-1 are specified in type C standards.

3.3 Function description

The pressure-sensitive safety device is supplied with PNOZmulti test pulse outputs. The test pulses are evaluated by PNOZmulti inputs (see section titled "Commissioning the safety system"). Short across contacts and open circuits are detected.

3.4 Configuration in the PNOZmulti Configurator

- ▶ Operating modes
 - Automatic reset/restart (Start):
After the pressure-sensitive protective device has been activated, the output immediately returns to "1" once the pressure-sensitive protective device is cleared.
 - Manual reset/restart (Start):
The output does not return to "1" until the start button has been pressed. This eliminates the possibility of the start button being overridden, triggering automatic activation. A reset/restart is only possible if the pressure-sensitive protective device is not activated.

- ▶ Start-up test
The start-up test prevents an automatic restart after a power failure and subsequent return of voltage. The unit checks whether the non-activated pressure-sensitive protective device was activated and cleared after supply voltage was applied.
- ▶ The output of the pressure-sensitive protective device function element is "1" if the pressure-sensitive protective device has **not** been activated. This safety function must be retained when this signal is linked further within the PNOZmulti Configurator:
 - Semiconductor outputs: High signal
 - Relay outputs: Safety contacts closed

3.4.1 Allocation of test pulses to inputs

The following test pulses must be used in pairs:

Test pulse T0 and test pulse T1

Test pulse T2 and test pulse T3

In other words, in the PNOZmulti Configurator the test pulses can only be assigned to the inputs as follows:

- ▶ Input 1: Test T0
- ▶ Input 2: Test pulse T1
- or
- ▶ Input 1: Test pulse T2
- ▶ Input 2: Test pulse T3



INFORMATION

Test pulses that you use for the pressure-sensitive protective device cannot be reused for test pulses in conjunction with other safety devices.

3.5 Commissioning the safety system


3.5.1 Preparing for commissioning

Please note the following when preparing for commissioning:


- ▶ Cables that have to be laid outside the control cabinet must be protected from mechanical damage, e.g. by installing them in a conduit.
- ▶ Do not route the test pulse lines together with actuator cables within an unprotected multicore cable.
- ▶ Pressure-sensitive protective devices may not be fitted with a terminating resistor.
- ▶ The configured test pulse outputs should be used exclusively for test pulses on the pressure-sensitive protective devices. It is essential to note the information provided under [Technical requirements](#)  25].

3.5.2 Preparing for operation

- ▶ Connect the pressure-sensitive protective device to the test pulse outputs and the inputs (in examples I0 to I3).
- ▶ Please note:
Always connect the pressure-sensitive protective devices to the PNOZmulti units via
 - the interface PSEN im1,
 - diodes of type 1 N4003 ...1N4007,
 - or via the terminal block with filter, order no. 774 195, 774 196.
 0 V may not be connected to the terminal block!

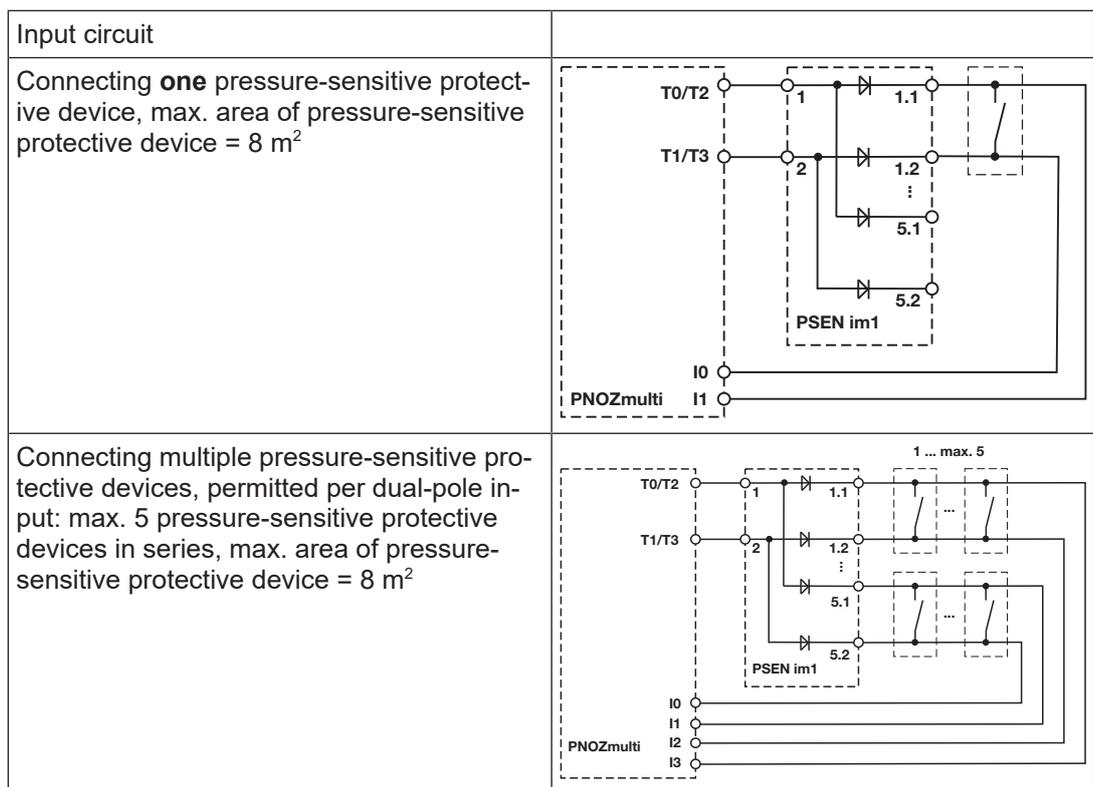

- ▶ Set the start features through wiring of the start circuit (in example I5). Only effective if *manual start/restart* is configured in the PNOZmulti Configurator.

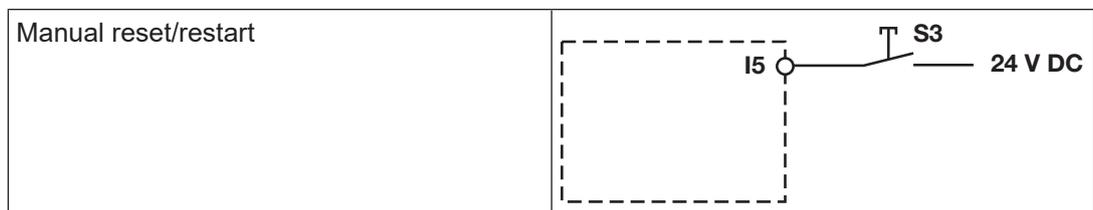

3.6 Operation

The safety system can only be started if the pressure-sensitive protective device has not been activated. The unit detects the operating mode set on start-up.

3.6.1 Diagnostic word

Messages can be queried in the PNOZmulti Configurator in bit mode and linked further within the program.

- ▶ Bit 0: Pressure-sensitive protective device clear, enable issued
- ▶ Bit 2: Pressure-sensitive protective device activated
- ▶ Bit 3: Waiting for reset/restart
- ▶ Bit 4: Waiting for start-up test
- ▶ Bit 6: Open circuit detected, signal error

3.7 Technical requirements

To ensure safe operation you must comply with the following values:

Response time (from activation of the pressure-sensitive protective device until an instantaneous safety output drops out)*	< 200 ms
Max. area of pressure-sensitive protective devices per dual-pole input	8 m²
Max. number of pressure-sensitive protective devices connected in series per dual-pole input	5
Max. number of dual-pole inputs that can be assigned to a test pulse pair	5
Min. conductor cross section	0.5 mm²
Max. cable length, PNOZmulti - pressure-sensitive protective device	100 m
Max. resistance of safety mat/safe edge	150 ohms

*The stated reaction time is the maximum value for pressure-sensitive protective devices. For details of the specific response time in conjunction with the respective approved safety mat or safe edge, please refer to the TÜV certificate for the respective product range (PNOZmulti or PNOZmulti 2).

4 Burners

4.1 Introduction

This chapter describes the control and monitoring of burners with the base units PNOZ m3p from the configurable small controllers PNOZmulti Classic or PNOZ m B1 Burner from the configurable small controllers PNOZmulti 2.

The control and monitoring of a burner is configured using the burner element in the PNOZmulti Configurator.

When using the burner element please also refer to:

- ▶ The operating manuals provided with the PNOZmulti units
- ▶ The online help for the PNOZmulti Configurator.

4.2 Safety

4.2.1 Intended use

The burner element can only be used in conjunction with the following devices:

- ▶ Base unit PNOZ m3p from the configurable small controllers PNOZmulti Classic or
- ▶ Base unit PNOZ m B1 Burner from the configurable small controllers PNOZmulti 2.

The burner element in the PNOZmulti Configurator is designed to control and monitor burners in accordance with the standards:

- ▶ EN 298: Automatic gas burner control systems for gas burners and gas burning appliances with and without fans
- ▶ EN 12953-7: Shell boilers
- ▶ EN 12952-8: Water-tube boilers and auxiliary installations
- ▶ EN 50156-1: Electrical equipment for furnaces
- ▶ EN 61508: SIL 3: Functional safety of safety-related electrical/electronic/programmable electronic systems
- ▶ EN 230: Automatic burner control systems for oil burners
- ▶ EN 267: Automatic forced draught burners for liquid fuels (draft)
- ▶ EN 298: Automatic gas burner control systems for gas burners and gas burning appliances with or without fans
- ▶ EN 676: Automatic forced draught burners for gaseous fuels
- ▶ EN 746-2: Industrial thermoprocessing equipment
- ▶ EN 1643: Valve proving systems for automatic shut-off valves for gas burners and gas appliances

Activation of a burner's safety valves in accordance with EN 50156:

- ▶ The following applies for configurable small controllers PNOZmulti Classic:
The relay output module PNOZ mo5p has diverse relay outputs and is therefore suitable for activating a burner's safety valves in accordance with EN 50156.
- ▶ The following applies for configurable small controllers PNOZmulti 2:
The relay output module PNOZ m EF 4DI4DOR can be used in furnaces. However, it does not have diverse relay outputs. To activate a burner's safety valves in accordance with EN 50156, appropriate external measures should be used to establish diversity of the shut-off elements.
For example, an appropriate measure may be an additional, monitored switching element (contactor or relay), which is activated by a safe semiconductor output and is switched in series with both relay outputs.

4.3 Configuration in the PNOZmulti Configurator

4.3.1 Functions

The burner element contains all the functions needed to control and monitor burners.

These include monitoring of

- ▶ Safety chains
- ▶ Combustion air pressure
- ▶ Ignition
- ▶ Flame monitoring
- ▶ External compound controller
- ▶ Tightness control

and control of

- ▶ Safety valves
- ▶ Ignition valves
- ▶ Vent valve
- ▶ Ignition
- ▶ External compound controller
- ▶ Combustion air blower

The following oil and gas burner types can be controlled and monitored:

- ▶ Master burner with direct ignition
- ▶ Master burner with indirect ignition and joint flame monitoring
- ▶ Master burner with indirect ignition and separate flame monitoring
- ▶ Slave burner with direct ignition
- ▶ Slave burner with indirect ignition and joint flame monitoring
- ▶ Slave burner with indirect ignition and separate flame monitoring

The required burner type and necessary monitoring and control functions can be set in the PNOZmulti Configurator (see Monitoring functions/settings for the burner cycle). This will influence the burner cycle.

A burner cycle has several phases (steps). The configuration determines which steps are carried out (see Burner cycle).

Provided the input signals match the set values within a step, the program cycle will be continued. The system will pass to the next step as soon as the configured step time has elapsed.

If the input signals do not match the set values within a step, an error will be detected. This will lead either to a fault lockout or a safety shutdown, depending on the input signal and configuration.

4.3.2 Monitoring functions/settings for the burner cycle

4.3.2.1 Combustion air pressure monitoring, activating the combustion air blower, compound controller monitoring

You can set whether the activated burner is a master burner or a slave burner.

▶ Master burners

Master burners have their own combustion air supply, which is controlled and monitored directly. The following monitoring/control functions are performed on master burners:

- The combustion air pressure is monitored. For this, the "AirP" input must be linked to the device that monitors the required air amount (generally an air pressure monitor).
- The combustion air blower is activated via the "BLOW" output.
- The compound controller can be activated and monitored. This is necessary when an electronic compound controller is present (see section below, entitled "Compound controller").

▶ Slave burners

Slave burners do not have their own combustion air supply. As a result, no monitoring takes place. This burner type is used for multi-burners, for example, which are fitted with a central combustion air supply and a monitoring function.



WARNING!

Loss of safety function due to incorrect use of the *Slave burner* type

If the *Slave burner* type is used to avoid pre-purge and a combustion air supply is not guaranteed, serious injury or death may result, depending on the application.

Only use the slave burner type if the combustion air supply is guaranteed elsewhere.

Please also note the following with the *Slave burner* type:

- ▶ The "AirP" input must be connected to a signal indicating the presence of a central combustion air supply that is functioning correctly. There is no check to ensure that this input is at rest position when the burner is switched off.
- ▶ The burner cannot be started (signal at the "Start" input) until it is guaranteed that there is no flammable mixture within the combustion chamber or associated areas or within the exhaust system.

4.3.2.2 Ignition

The ignition transformer is activated via the "IGNT" output.

You can select two types of ignition in the PNOZmulti Configurator:

► Direct ignition

With direct ignition, no separate ignition burner is present. The main burner is ignited directly via the ignition transformer.


► Indirect ignition

With indirect ignition, a separate ignition burner is present. The main burner is ignited by an ignition flame, which is ignited via an ignition transformer. Fuel may not be supplied to the main burner until the ignition burner has been ignited and the ignition flame is stable. The ignition valve is activated via the IV output.

The following setting options are available for the behaviour of the ignition flame:

- Ignition valve is closed after ignition, i.e. the ignition flame is to be extinguished once the main burner is successfully ignited, or
- (only possible when separate flame monitoring is configured (see section entitled "Flame monitoring")): Ignition valve remains open after ignition, i.e. the ignition flame is to stay lit once the main burner is successfully ignited.

The ignition valve must be positioned as follows:

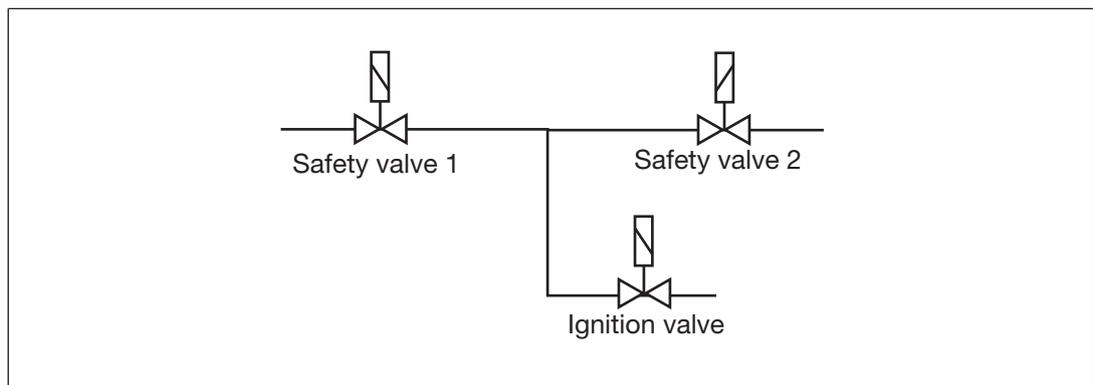

4.3.2.3 Flame monitoring

Flame monitoring is used to establish and signal the presence of a flame. To ensure that the signal is actually a result of the flame and not of some external light source, the absence of the flame is monitored during a burner cycle (e.g. during pre-purge). With direct ignition, the main flame is monitored.

With indirect ignition you can select between two types of flame monitoring:

► Joint flame monitoring

Ignition flame and main flame are monitored jointly. The FLAM input for the main flame must be logically linked to flame monitoring. The FLAI input for the ignition flame will not then be evaluated.

► Separate flame monitoring

Ignition flame and main flame are monitored separately; each have their own flame monitoring device.

4.3.2.4 Compound controller

If master burners have an external electronic compound controller, the compound controller must be activated and monitored via the burner element

The compound controller controls and monitors the fuel/air ratio. The regulating devices for the amount of combustion air and fuel are activated for this purpose.

- ▶ The "PURG" output is activated during the step: "Compound controller to pre-purge position". This output signal is intended to switch the compound controller to the pre-purge position (maximum amount of combustion air).
- ▶ During the steps "Pre-purge ...", a signal is expected at the "PUR" input from the compound controller, indicating that the compound controller is in "pre-purge" position. This signal must not occur until the airflow rate required for pre-purge is present.
- ▶ The "IGNI" output is activated during the step: "Compound controller to ignition position". This output signal is intended to switch the compound controller to the ignition position (optimum fuel/air ratio for ignition).
- ▶ During the steps "Ignition ...", a signal is expected at the "IGN" input from the compound controller, indicating that the compound controller is in "ignition" position. This signal must not occur until the optimum fuel/air ratio for ignition is present.


4.3.2.5 Tightness control

You can select whether to carry out tightness control. With tightness control, the section between the two safety valves will first be vented, then refilled and the pressure measured. The pressure is monitored at the "GP" input.

The plant must undergo a hazard analysis to determine whether tightness control is necessary. The hazard analysis should also determine whether venting is permitted via safety valve 2.

The following configuration options are available:

- ▶ Vent via the vent valve (the vent valve is activated via the VV output)
The vent valve must be positioned as follows:

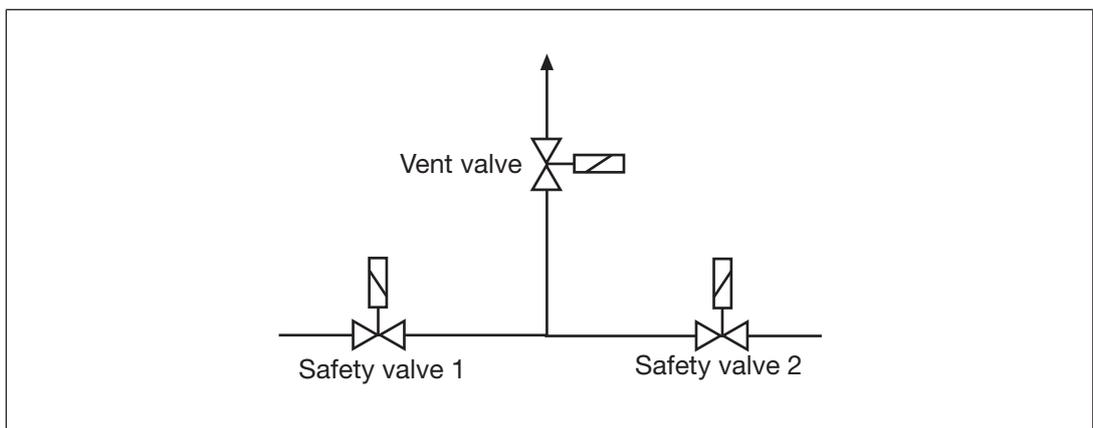

or

- ▶ Vent via safety valve 2
- ▶ Continuous vent (in which case, tightness control is not carried out)
- ▶ No tightness control and no continuous vent

It's also possible to configure when tightness control is to be carried out:

- ▶ Tightness control prior to ignition
- ▶ Tightness control after the burner has shut down. (Even with this setting, tightness control will be carried out prior to ignition if the previous burner cycle was interrupted due to an error.)

4.3.2.6 High temperature

"High temperature" mode can be activated via the "HTmp" input if the conditions for high temperature in high temperature plants have been met in accordance with EN 746-2 and the fuel in the combustion chamber self-ignites safely.

As the fuel in the combustion chamber self-ignites in high temperature mode, the burner cycle will change.

The following steps are no longer performed in high temperature mode:

- ▶ Any steps in connection with pre-purge and post-purge
- ▶ Tightness control
- ▶ Pre-ignition
- ▶ Afterburn

Flame monitoring is also deactivated; the outputs for activating "Compound controller for pre-purge position" (PURG) and the ignition transformer (IGNT) are no longer activated.



WARNING!

Potential loss of safety functions in "High temperature" mode!

If the conditions for high temperature in accordance with EN 746-2 are not met, safety-related steps in "High temperature" mode will no longer be carried out. Depending on the application, serious injury or death may result. Make sure that "High temperature" mode is only active when the conditions for high temperature in accordance with EN 746-2 are met.

In any of the steps within the cycle, the "HTmp" input can be used to switch between high temperature mode and normal mode (see also section entitled "Inputs and outputs").

4.3.2.7 Plant-dependent monitoring functions

Plant-dependent monitoring functions, which are intended to trigger a burner shutdown where necessary (e.g. when the temperature is too high), must be incorporated into the safety sequences. In other words, they must be linked to inputs CHA1, CHA2 or CHAi.

Monitoring functions which are intended to be active from burner start-up to burner shut-down must be linked to either CHA1 or CHA2.

Monitoring functions which are only intended to be active during ignition and burner operation must be linked to CHAi (see also section entitled "Inputs and outputs").

4.3.2.8 Shutdown types

A controlled shutdown can be performed via the "Stop" input (e.g. if energy is no longer required). The burner is then brought to a stop.



WARNING!

Loss of safety function due to incorrect use of the "Stop" input!

If the "Stop" input is used to reproduce a safety shutdown or fault lockout, serious injury or death may result, depending on the application. Only use the "Stop" input for a controlled shutdown.

An error is detected if the input signals within a step do not match the values set for the monitoring operation. This will lead either to a fault lockout or a safety shutdown, depending on the input signal and configuration. With both shutdown types, all outputs on the burner element are shut down immediately and the sequence program is aborted.

▶ Safety shutdown

After a safety shutdown, the burner cycle is automatically restarted after a configurable period, if there is no error present.

▶ Fault lockout

With a fault lockout, if there is no error present, it is necessary to reset and then manually restart to enable a new burner cycle.

For the following steps you can select which shutdown type will occur in the event of an error in the PNOZmulti Configurator:

- ▶ Safety chain 1 broken (input CHA1)
- ▶ Safety chain 2 broken (input CHA2)
- ▶ Ignition and operation safety chain broken (input CHAi)
- ▶ No air pressure during operation (during start-up: fault lockout)
- ▶ Faulty flame signal during operation (during start-up: fault lockout)

Please note:

The plant must undergo a hazard analysis to determine whether a safety shutdown is permitted for an error.

4.3.2.9 Step times

You can set a time for most of the steps within a cycle (see View burner cycle, define step times). The time determines how long the step will be active. While the step is active, the inputs must conform to the pre-defined set values. Once this time has elapsed, the next step will be started (see also Burner cycle).

When configuring the step times, please note the following with the steps below:

▶ Steps 5 - 9 "Pre-purge...)

The total duration of steps 5 - 9 for pre-purge must not be less than the minimum duration for pre-purge calculated via the plant's hazard analysis.

▶ Step 13 "Ignite ignition flame / 1st safety time"

The configured step time must not be longer than the 1st safety time. The maximum duration of the 1st safety time is calculated based on a hazard analysis of the plant.

▶ Step 15 "Ignite ignition flame / 2nd safety time"

The configured step time must not be longer than the 2nd safety time. The maximum duration of the 2nd safety time is calculated based on a hazard analysis of the plant.

A step time cannot be set for the following steps: "Burner switched off", "Check start conditions" and "Burner in operation/control enable".

4.4 Burner cycle

4.4.1 Steps

Each step has a fixed step identifier (0 ... 31).

The steps are performed consecutively within the burner cycle (step 1 first, then step 2).

Some steps are only important internally and are not displayed (e.g. step 4). That's why some numbers from 0 to 31 are not listed as steps.

The length of the steps depends on the configuration and the burner cycle. There are steps for which you can set a step time in the PNOZmulti Configurator; others have a fixed step time, or the step time depends on the burner cycle.

A step time cannot be set for the following steps. They are run in each burner cycle, irrespective of the configuration.

- ▶ Step 0: Burner switched off
- ▶ Step 1: Check start conditions
- ▶ Step 18: Burner in operation/controller enable

A step time can be set for the following steps. Your configuration will determine which of these steps are performed in your burner cycle.

- ▶ Step 2: Start-up combustion air blower
- ▶ Step 3: Compound controller to pre-purge position
- ▶ Step 5: Pre-purge/tightness control: Vent
- ▶ Step 6: Pre-purge/tightness control: Test air pressure
- ▶ Step 7: Prepurge/tightness control, filling:
- ▶ Step 8: Prepurge/tightness control, test fuel pressure
- ▶ Step 9: Continue pre-purge
- ▶ Step 10: Compound controller to ignition position
- ▶ Step 12: Pre-ignition
- ▶ Step 13: Ignite ignition flame/1st safety time
- ▶ Step 14: Stabilise ignition flame
- ▶ Step 15: Ignite main flame/2nd safety time
- ▶ Step 16: Stabilise main flame
- ▶ Step 17: Burner in operation/start position
- ▶ Step 20: Afterburn
- ▶ Step 21: Post-purge

- ▶ Step 22: Run down combustion air blower
- ▶ Step 24: Tightness control, vent
- ▶ Step 25: Tightness control, test air pressure
- ▶ Step 26: Tightness control, filling
- ▶ Step 27: Tightness control, test fuel pressure

4.4.2 Errors during the burner cycle

An error is detected if the input signals within a step fail to match the values set for the monitoring operation. This will lead either to a fault lockout or a safety shutdown, depending on the input signal and configuration. Some of the monitoring functions during a burner cycle depend on the step, while others are continuous. In other words, some monitoring processes occur in a specific step, while others may be active across the whole cycle.

▶ **Step-dependent errors**

With step-dependent errors, the set value of the input signals in the various steps may vary.

E.g.: With combustion air monitoring, the input must have a "0" signal during the "Check start conditions" step and a "1" signal during the "Burner in operation" step.

The following monitoring functions have errors that depend on the specific step:

- Combustion air monitoring
- Flame monitoring of ignition flame
- Flame monitoring of main flame
- Tightness control
- Compound controller not in pre-purge position
- Compound controller not in ignition position
- Ignition and operation safety chain

▶ **Step-independent errors**

Where errors are independent of the specific step, the same set value applies for each step: The input must have a "1" signal.

The following monitoring functions have errors that are independent of the specific step:

- Safety chain 1
- Safety chain 2

4.4.3 Master burner with direct ignition

			Steps																										
Inputs		Configuration	0	1	2	3	5	6	7	8	9	10	12	15	16	17	18	20	21	22	24	25	26	27					
CHA1			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
CHA2			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
CHAi			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
AirP			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
FLAM			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
PUR	mVB		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
	oVB	UVa	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
		UVe	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
IGN	mVB		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
	oVB	UZa	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
		UZe	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■				
GP		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■					
Outputs																													
SV1									■																				
SV2	EE	So																											
		Sz																											
	ES	So																											
		Sz																											
	kDK	So																											
		Sz																											
IV	Zz																												
	Zo																												
VV	EE																												
	ES																												
	kDK																												
	DE	So																											
Sz																													
IGNT																													
BLOW																													
PURG	mVB																												
	oVB																												
IGNI	mVB																												
	oVB																												
STRT	mVB																												
	oVB																												
CONT																													
Step execution	mVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X				
		DKn	X	X	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X				
		kDK	X	X	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X			
	oVB	DKv	X	X	X	-	X	X	X	X	X	-	X	X	X	-	X	X	X	X	X	X	X	X	X	X			
		DKn	X	X	X	-	-	-	-	-	X	-	X	X	X	-	X	X	X	X	X	X	X	X	X	X			
		kDK	X	X	X	-	-	-	-	-	X	-	X	X	X	-	X	X	X	X	X	X	X	X	X	X			

Configuration:

mVB: Cycle with compound controller
oVB: Cycle without compound controller
UZe: Monitoring of ignition conditions on
UZa: Monitoring of ignition conditions off
UVe: Monitoring of pre-purge conditions on
UVa: Monitoring of pre-purge conditions off
DE: Continuous vent
DKv: Tightness control prior to ignition
DKn: Tightness control after shutdown

kDK: No tightness control,
no continuous vent
EE: Vent via vent valve
ES: Vent via safety valve 2
Zz: Ignition valve is closed after ignition
Zo: Ignition valve remains open after ignition
So: Safety valve 2 open during
afterburn
Sz: Closed

Status of inputs/outputs:

■ Signal must be/is '1'
□ No monitoring active
□ Signal must be/is '0'

Step execution

X Step is executed
- Step is not executed

4.4.5 Master burner with joint flame monitoring

			Steps																										
Inputs	Confi- guration		0	1	2	3	5	6	7	8	9	10	12	13	14	15	16	17	18	20	21	22	24	25	26	27			
		CHA1																											
CHA2																													
CHAI																													
AirP																													
FLAM																													
PUR	mVB																												
	oVB	UVa																											
		UVe																											
IGN	mVB																												
	oVB	UZa																											
		UZe																											
GP																													
Outputs																													
SV1																													
SV2	EE	So																											
		Sz																											
	ES	So																											
		Sz																											
	kDK	So																											
		Sz																											
IV	Zz																												
	Zo																												
VV	EE																												
	ES																												
	kDK																												
	DE	So																											
Sz																													
IGNT																													
BLOW																													
PURG	mVB																												
	oVB																												
IGNI	mVB																												
	oVB																												
STRT	mVB																												
	oVB																												
CONT																													
Step execution	mVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X			
		DKn	X	X	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
	oVB	kDK	X	X	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
		DKv	X	X	X	-	X	X	X	X	X	-	X	X	X	X	X	-	X	X	X	X	X	X	X	X	X		
		DKn	X	X	X	-	-	-	-	-	X	-	X	X	X	X	X	-	X	X	X	X	X	X	X	X	X		
		kDK	X	X	X	-	-	-	-	-	X	-	X	X	X	X	X	-	X	X	X	X	X	X	X	X	X		

Configuration:

mVB: Cycle with compound controller
oVB: Cycle without compound controller
UZe: Monitoring of ignition conditions on
UZa: Monitoring of ignition conditions off
UVe: Monitoring of pre-purge conditions on
UVa: Monitoring of pre-purge conditions off
DE: Continuous vent
DKv: Tightness control prior to ignition
DKn: Tightness control after shutdown

kDK: No tightness control,
no continuous vent
EE: Vent via vent valve
ES: Vent via safety valve 2
Zz: Ignition valve is closed after ignition
Zo: Ignition valve remains open after ignition
So: Safety valve 2 open during
afterburn
Sz: Closed

Status of inputs/outputs:

■ Signal must be/is '1'
□ No monitoring active
□ Signal must be/is '0'

Step execution:

■ Step is executed
□ Step is not executed

4.4.6 Slave burner with direct ignition

			Steps															
Inputs		Configuration	0	1	5	6	7	8	12	15	16	18	20	24	25	26	27	
CHA1			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
CHA2			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
CHAi			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
AirP			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
FLAM			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
IGN	UZa		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
	UZe		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
GP			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	
Outputs																		
SV1							■			■	■	■	■				■	
SV2	EE	So									■	■	■	■				
		Sz												■	■			
	ES	So		■											■	■		
		Sz																
kDK	So																	
	Sz																	
IV	Zz																	
	Zo																	
VV	EE			■												■		
	DE	So																
		Sz																
IGNT								■	■	■	■	■						
CONT													■					
Step execution	mVB	DKv	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-	
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	-	X	X	X	X	X	X	-	-	-	-
	oVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	-	X	X	X	X	X	X	-	-	-	-

Configuration:

mVB: Cycle with compound controller
oVB: Cycle without compound controller
UZe: Monitoring of ignition conditions on
UZa: Monitoring of ignition conditions off
UVe: Monitoring of pre-purge conditions on
UVa: Monitoring of pre-purge conditions off
DE: Continuous vent
DKv: Tightness control prior to ignition
DKn: Tightness control after shutdown

kDK: No tightness control,
_____ no continuous vent
EE: Vent via vent valve
ES: Vent via safety valve 2
Zz: Ignition valve is closed after ignition
Zo: Ignition valve remains open after ignition
Safety valve 2 open during
Sz: afterburn
So: Closed

Status of inputs/outputs:

■ Signal must be/is '1'
■ No monitoring active
□ Signal must be/is '0'

Step execution:

X Step is executed
- Step is not executed

4.4.7 Slave burner with separate flame monitoring

			Steps																	
Inputs	Confi- guration		0	1	5	6	7	8	12	13	14	15	16	18	20	24	25	26	27	
			CHA1			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
CHA2			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
CHAi			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
AirP			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
FLAM			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
FLAI	Sz		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
	So		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
IGN	UZa		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
	UZe		■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
GP			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
Outputs																				
SV1							■			■	■	■	■	■	■	■	■	■	■	■
SV2	EE	So																		
		Sz																		
	ES	So		■																
		Sz		■																
	kDK	So																		
Sz																				
IV	Zz																			
	Zo																			
VV	EE		■																	
	ES		■																	
	kDK																			
	DE	So																		
Sz																				
IGNT																				
CONT																				
Step execution	mVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-	
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	-	X	X	X	X	X	X	X	X	-	-	-	-
	oVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	X	X	X	X	X	X	X	X	-	-	-	-	

Configuration:

mVB: Cycle with compound controller
oVB: Cycle without compound controller
UZe: Monitoring of ignition conditions on
UZa: Monitoring of ignition conditions off
UVe: Monitoring of pre-purge conditions on
UVa: Monitoring of pre-purge conditions off
DE: Continuous vent
DKv: Tightness control prior to ignition
DKn: Tightness control after shutdown

kDK: No tightness control,
no continuous vent
EE: Vent via vent valve
ES: Vent via safety valve 2
Zz: Ignition valve is closed after ignition
Zo: Ignition valve remains open after ignition
So: Safety valve 2 open during
afterburn
Sz: Closed

Status of inputs/outputs:

■ Signal must be/is '1'
■ No monitoring active
□ Signal must be/is '0'

Step execution:

X Step is executed
- Step is not executed

4.4.8 Slave burner with joint flame monitoring

			Steps																	
Inputs		Configuration	0	1	5	6	7	8	12	13	14	15	16	18	20	24	25	26	27	
CHA1																				
CHA2																				
CHAi																				
AirP																				
FLAM																				
IGN	UZa																			
	UZe																			
GP																				
Outputs																				
SV1																				
SV2	EE	So																		
		Sz																		
	ES	So																		
		Sz																		
kDK	So																			
	Sz																			
IV	Zz																			
	Zo																			
VV	EE																			
	ES																			
	kDK																			
	DE	So																		
		Sz																		
IGNT																				
CONT																				
Step execution	mVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-	
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	-	X	X	X	X	X	X	X	-	-	-	-	-
	oVB	DKv	X	X	X	X	X	X	X	X	X	X	X	X	X	-	-	-	-	-
		DKn	X	X	-	-	-	-	X	X	X	X	X	X	X	X	X	X	X	X
		kDK	X	X	-	-	-	-	X	X	X	X	X	X	X	-	-	-	-	-

Configuration:

mVB: Cycle with compound controller
oVB: Cycle without compound controller
UZe: Monitoring of ignition conditions on
UZa: Monitoring of ignition conditions off
UVe: Monitoring of pre-purge conditions on
UVa: Monitoring of pre-purge conditions off
DE: Continuous vent
DKv: Tightness control prior to ignition
DKn: Tightness control after shutdown

kDK: No tightness control,
_____ no continuous vent
EE: Vent via vent valve
ES: Vent via safety valve 2
Zz: Ignition valve is closed after ignition
Zo: Ignition valve remains open after ignition
So: Safety valve 2 open during afterburn
Sz: Closed

Status of inputs/outputs:

■ Signal must be/is '1'
■ No monitoring active
□ Signal must be/is '0'

Step execution:

■ Step is executed
- Step is not executed

4.4.9 Example: Viewing the burner cycle in the PNOZmulti Configurator

The steps listed above will be performed during the burner cycle, depending on the configuration.

Once you have made the settings for your configuration in the PNOZmulti Configurator, you can then view the burner cycle. The following information may be displayed:

- ▶ An overview of your configuration
- ▶ The steps that are performed with this configuration
- ▶ The set status of the inputs and the status of the outputs during the respective steps

Example:

You have made the following settings in the PNOZmulti Configurator:

Burner type	Master burner, indirect ignition, separate flame monitoring
Cycle with compound control- ler	Activated
Ignition valve	Closed after ignition
Type of tightness control	Vent via vent valve
Time of tightness control	During pre-purge
Afterburn	Safety valve 2 is closed during afterburn
Temperature	Enable 'High temperature' operating mode

The following 2 tables are displayed in the PNOZmulti Configurator: *Set status of inputs* and *Status of outputs*. Your own individual burner cycle is represented in these tables.

The first row contains all the steps that will be performed during the burner cycle (step identifiers 0 ... 31).

The first column contains all the inputs/outputs used in your application.

The field markings show the set status of the inputs and the status of the outputs during the respective steps:

- Black An input must = "1" in the step concerned, or an output = "1" in the step concerned.
- White An input or output must = "0" in the step concerned, or an output = "0" in the step concerned.
- Grey Monitoring of an input is deactivated in the step concerned, i.e. it is not evaluated.

Set status of inputs

	0	1	2	3	5	6	7	8	9	10	12	13	14	15	16	17	18	20	21	22	
CHA1																					
CHA2																					
CHAI																					
AirP																					
FLAM																					
FLAI																					
PUR																					
IGN																					
GP																					

Examples:

- ▶ In step 2, "Start-up combustion air blower", the safety chain must be closed (input CHA2 = 1)
- ▶ In step 1, "Check start conditions", a main flame must not be detected (input FLAM = 0).

Status of outputs

	0	1	2	3	5	6	7	8	9	10	12	13	14	15	16	17	18	20	21	22	
SV1							■					■	■	■	■	■	■	■			
SV2														■	■	■	■	■			
IV												■	■	■	■						
VV					■																
IGNT											■	■	■								
BLOW			■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■
PURG			■	■	■	■	■	■	■	■										■	
IGNI											■	■	■	■	■	■	■				
STRT																	■				
CONT																		■			

Examples:

- ▶ In step 5 "Pre-purge/tightness control: Vent", the vent valve is activated (output VV = 1).
- ▶ In step 9 "Continue pre-purge", the ignition transformer is not activated (output IGNT = 0).

4.5 Inputs and outputs

4.5.1 Element's inputs

4.5.1.1 Operation

▶ Start: Switch burner on

The cycle is started via the start signal. The system can only be started if no error is present.

Start = 0, no action

Start = 1, switch burner on (pulse edge 0 -> 1)

▶ Stop: Switch burner off

Shutdown of the burner is started via the stop signal.

Stop = 0, no action

Stop = 1, switch off burner

▶ Reset: Fault lockout/reset error

The reset input is used to cancel the restart interlock after a fault lockout. A reset signal resets the cycle to "Burner switched off" status; the burner cycle can be restarted using the start signal.

Reset = 0, no action

Reset = 1, reset (pulse edge 0 -> 1)

4.5.1.2**Monitoring functions****▶ CHA 1: Safety chain 1**

The inputs can be assigned to any signals. We recommend that you connect E-STOP pushbuttons, which switch off the burner in an emergency, or plant-dependent monitoring functions, such as temperature or pressure monitoring devices, for example.

CHA 1 = 0: Safety chain interrupted

CHA 1 = 1: Safety chain closed

▶ CHA 2: Safety chain 2

Safety chain 2 has the same function as safety chain 1. Both safety chains are of equal value. They are differentiated to improve diagnostics.

CHA 2 = 0: Safety chain interrupted

CHA 2 = 1: Safety chain closed

▶ CHAi: Ignition and operation safety chain

This input has the same function as safety chains 1 and 2. However, when there is a 0 signal, a fault lockout or safety shutdown will only occur in between the steps Pre-ignition and Burner in operation, inclusive. If the input has a 0 signal before or after this point, it will have no effect.

CHAi = 0: Safety chain interrupted

CHAi = 1: Safety chain closed

▶ AirP: Combustion air pressure monitoring

The combustion air pressure is monitored at this input.

AirP = 0: Combustion air pressure absent

AirP = 1: Combustion air pressure present

On slave burners it is assumed that the furnace is fitted with a central combustion air supply. In this case, the "AirP" input must be connected to a signal indicating the presence of a correctly functioning combustion air supply.

▶ FLAM: Flame monitoring of main flame

The main flame is monitored at this input. If a burner type with joint flame monitoring is configured, this input will also be used to monitor the ignition flame.

FLAM = 0: Flame absent

FLAM = 1: Flame present

▶ FLAI: Flame monitoring for ignition flame

If a burner type with separate flame monitoring is configured, this input will be used to monitor the ignition flame.

FLAI = 0: Ignition flame absent

FLAI = 1: Ignition flame present

▶ PUR: Compound controller in pre-purge position

At this input, a signal is expected from the compound controller, indicating that the compound controller is in "pre-purge" position. This signal must not come from the compound controller until the airflow rate required for pre-purge is present.

PUR = 0: Compound controller not in pre-purge position

PUR = 1: Compound controller in pre-purge position

► **IGN: Compound controller in ignition position**

At this input, a signal is expected from the compound controller, indicating that the compound controller is in "ignition" position. This signal must not occur until the optimum fuel/air ratio for ignition is present.

IGN = 0: Compound controller not in ignition position

IGN = 1: Compound controller in ignition position

► **GP: Tightness control (gas pressure)**

The pressure between the two safety valves is monitored at this input.

GP = 0: Section vented (atmospheric pressure)

GP = 1: Gas pressure present

► **HTmp : High temperature mode**

This input is used to switch between "Normal mode" and "High temperature mode". It is only possible to switch to high temperature mode if *Allow "High temperature" mode* has been selected in the PNOZmulti Configurator.

HTmp = 0: Normal operation

HTmp = 1: High temperature

4.5.2

Element's outputs

► **SV1: Safety valve 1**

Safety valve 1 is activated via this output. Safety valve 1 is on the fuel side.

SV 1 = 0: Close safety valve 1

SV 1 = 1: Open safety valve 1

If the safety valves are activated via relay outputs, the special requirements of EN 50156 must be considered.

– For PNOZmulti Classic systems we recommend that the safety valves are activated via the PNOZmulti expansion module PNOZ mo5p (see section entitled "Examples", under "Connecting the safety valves").

– For PNOZmulti 2 systems, the relay output module PNOZ m EF 4DI4DOR can be used. However, it does not have diverse relay outputs. To activate a burner's safety valves in accordance with EN 50156, appropriate external measures should be used to establish diversity of the shut-off elements.

For example, an appropriate measure may be an additional, monitored switching element (contactor or relay), which is activated by a safe semiconductor output and is switched in series with both relay outputs.

► **SV2: Safety Valve 2**

Safety valve 2 is activated via this output. Safety valve 2 is on the burner side.

SV 2 = 0: Close safety valve 2

SV 2 = 1: Open safety valve 2

If the safety valves are activated via relay outputs, the special requirements of EN 50156 must be considered.

– For PNOZmulti Classic systems we recommend that the safety valves are activated via the PNOZmulti expansion module PNOZ mo5p (see section entitled "Examples", under "Connecting the safety valves").

- For PNOZmulti 2 systems, the relay output module PNOZ m EF 4DI4DOR can be used. However, it does not have diverse relay outputs. To activate a burner's safety valves in accordance with EN 50156, appropriate external measures should be used to establish diversity of the shut-off elements.

For example, an appropriate measure may be an additional, monitored switching element (contactor or relay), which is activated by a safe semiconductor output and is switched in series with both relay outputs.

▶ **IV: Ignition valve**

The ignition valve is activated via this output.

IV = 0: Close ignition valve

IV = 1: Open ignition valve

▶ **VV: Vent valve**

The vent valve is activated via this output. If tightness control is not configured but continuous vent is, this valve must be designed to be "normally open". If neither tightness control nor continuous vent is configured, the output is inactive.

VV = 0: Close vent valve

VV = 1: Open vent valve

▶ **IGNT: Ignition transformer**

The ignition transformer is activated via this output.

IGNT = 0: Switch off ignition transformer

IGNT = 1: Switch on ignition transformer

▶ **BLOW: Combustion air blower**

The combustion air blower is activated via this output.

BLOW = 0: Switch off combustion air blower

BLOW = 1: Switch on combustion air blower

▶ **PURG: Compound controller to pre-purge position**

This output is used to signal to the compound controller to go to pre-purge position.

PURG = 0: Compound controller not activated

PURG = 1: Compound controller to pre-purge position

▶ **IGNI: Compound controller to ignition position**

This output is used to signal to the compound controller to go to ignition position.

IGNI = 0: Compound controller not activated

IGNI = 1: Compound controller to ignition position

▶ **STRT: Compound controller: Start position**

This output is used to signal to the compound controller to go to start position.

STRT = 0: Compound controller not activated

STRT = 1: Compound controller to start position

▶ **CONT: Controller enable**

This output provides the signal for the controller enable.


CONT = 0: No controller enable

CONT = 1: Controller enable

4.6 Configuration examples

4.6.1 Burner configuration

4.6.1.1 Burner structure

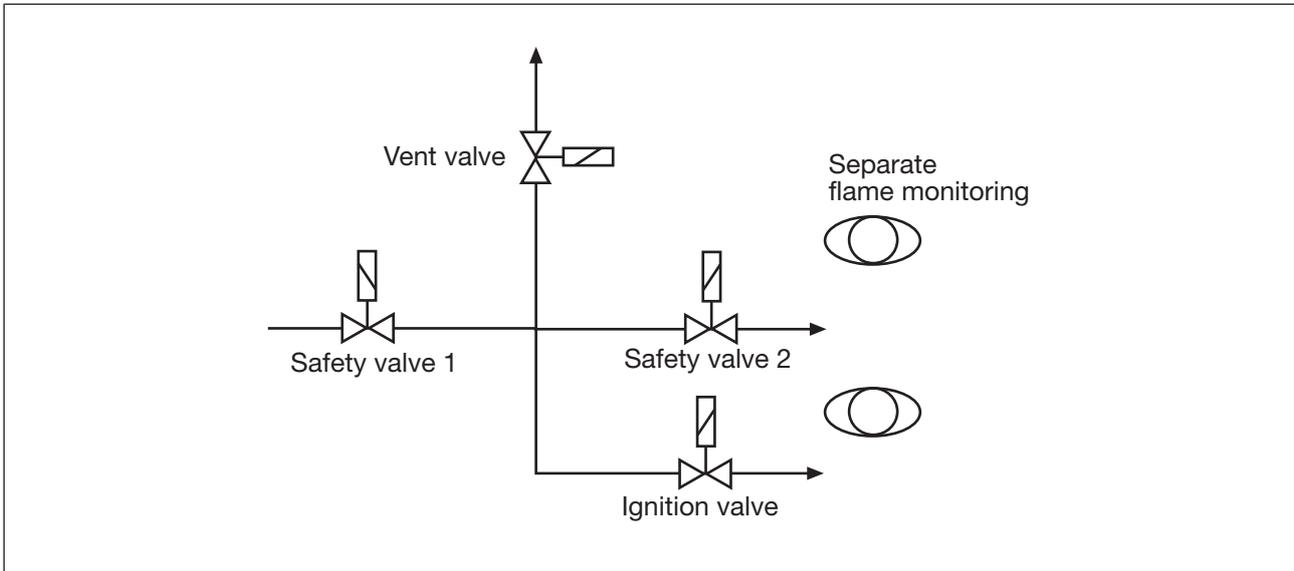

4.6.1.2 Burner properties

The burner has the following properties:

- ▶ The burner has its own combustion air supply.
- ▶ An electronic compound controller is present
- ▶ A separate ignition burner is present
- ▶ The ignition flame is extinguished once the main burner is successfully ignited.
- ▶ Ignition and main flame are each monitored using their own flame monitoring device.
- ▶ A tightness control check is carried out prior to ignition (during pre-purge).
- ▶ With tightness control, the section between the two safety valves is vented via the vent valve.
- ▶ Safety valve 2 is closed during afterburn.

4.6.1.3 Configuration in the PNOZmulti Configurator

Select burner type

Burner properties	Configuration
Own combustion air supply	Master burner
Separate ignition burner	Indirect ignition
Separate monitoring of ignition and main flame	Separate flame monitoring

► Select *Master burner, indirect ignition, separate flame monitoring*

Configure compound controller monitoring

Burner properties	Configuration
Electronic compound controller present	<i>Cycle with compound controller</i>

Configure combustion air pressure monitoring

Burner properties	Configuration
A bounce time must be stated for shutting down the combustion air blower	Debounce time: <i>300 ms</i>

Configure ignition

Burner properties	Configuration
Ignition flame is extinguished once the main burner is ignited	Ignition valve <i>Closed after ignition</i>

Configure tightness control

Burner properties	Configuration
Vent via vent valve	Type of tightness control <i>Vent via vent valve</i>
Tightness control occurs prior to ignition	Time of tightness control <i>Prior to ignition</i>

Configure settings for shutting down the burner

Burner properties	Configuration
Safety valve 2 is closed during afterburn.	<i>Safety valve 2 is closed during afterburn</i>

4.6.2 Connecting the safety valves on PNOZmulti Classic systems


If the safety valves are activated via relay outputs, diverse relays must be used.

For PNOZmulti Classic systems, the relay output module PNOZ mo5p is provided for this purpose. This module has 4 relay outputs:

Output O0 is diverse from O1,

Output O2 is diverse from output O3

Connecting the safety valves on a burner in accordance with EN 50156

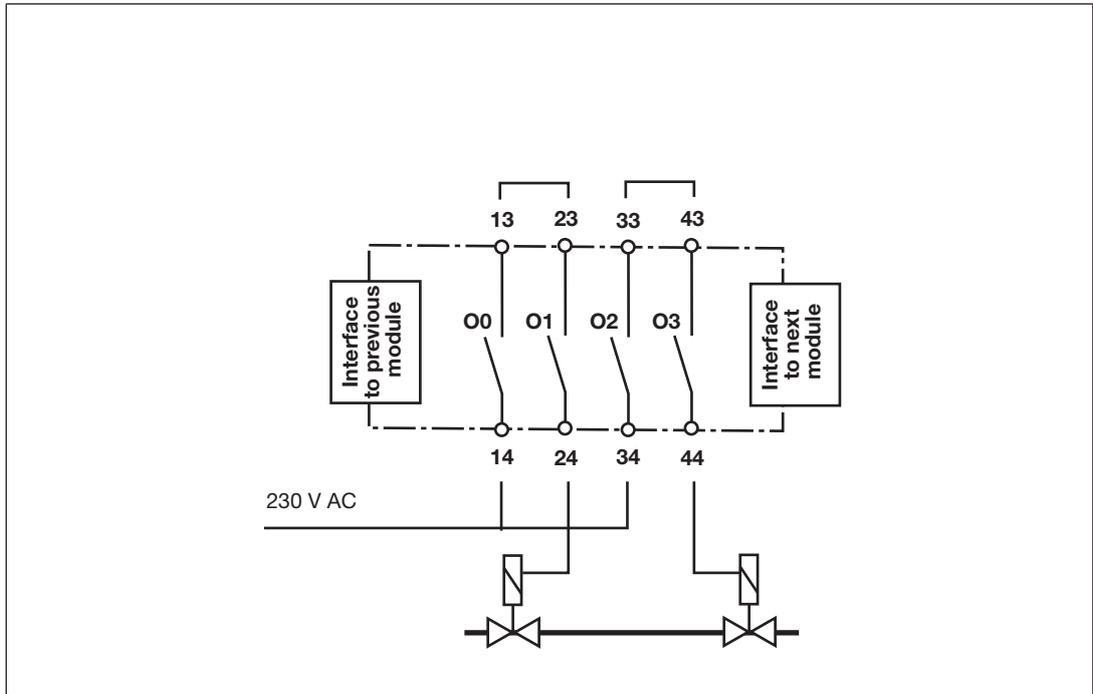

5 Loop formation (LOOP)

5.1 Introduction

This chapter describes the "Loop formation" function, in which LOOP inputs and outputs are configured in the PNOZmulti Configurator. This function is available from Version 8.1.0 of the PNOZmulti Configurator. Details of which base units support Version 8.1.0 are available in the "Product Modifications" document in the "Version overview" section.

5.1.1 Intended use

The loop formation (LOOP) function is used to feedback output information to the inputs.




NOTICE

When forming a loop, please note that the switch-off delay of the connected output is increased (see section entitled "Function description").

5.2 Function description

The connection of an output to an input of the same element is detected as an invalid loop in the PNOZmulti Configurator and cannot be configured in the user program.

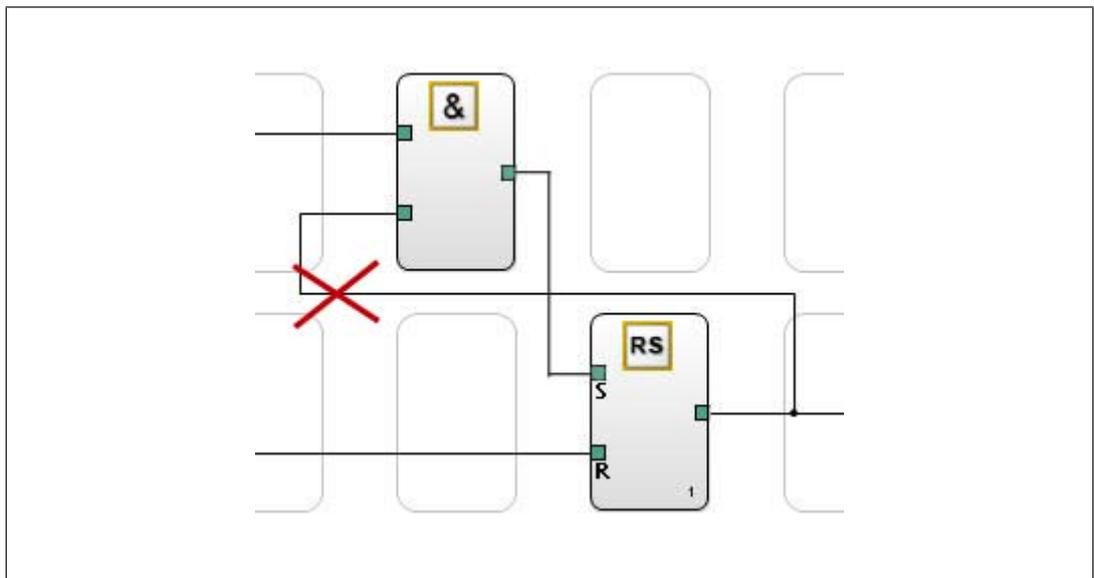

Such a loop is necessary in certain applications. For example, applications containing a step sequence, where the status of the previous step influences the step that follows.

To meet this requirement you can configure a LOOP output and one or more assigned LOOP inputs in the PNOZmulti Configurator.

The output information from the LOOP output is then made available to the assigned LOOP inputs.




NOTICE

When forming a loop, please note that the presence of the output signal at the LOOP input is delayed by up to one cycle (15 ms); as a result, the switch off delay of the connected output is increased by up to one cycle.

5.3 Example configurations

5.3.1 Application using one loop

In the example configuration below, the status of the "LOOP 0" output is made available one cycle later at the "LOOP 0" input. Logically, the "Output 2" output switches one cycle later than the "Output1" output.

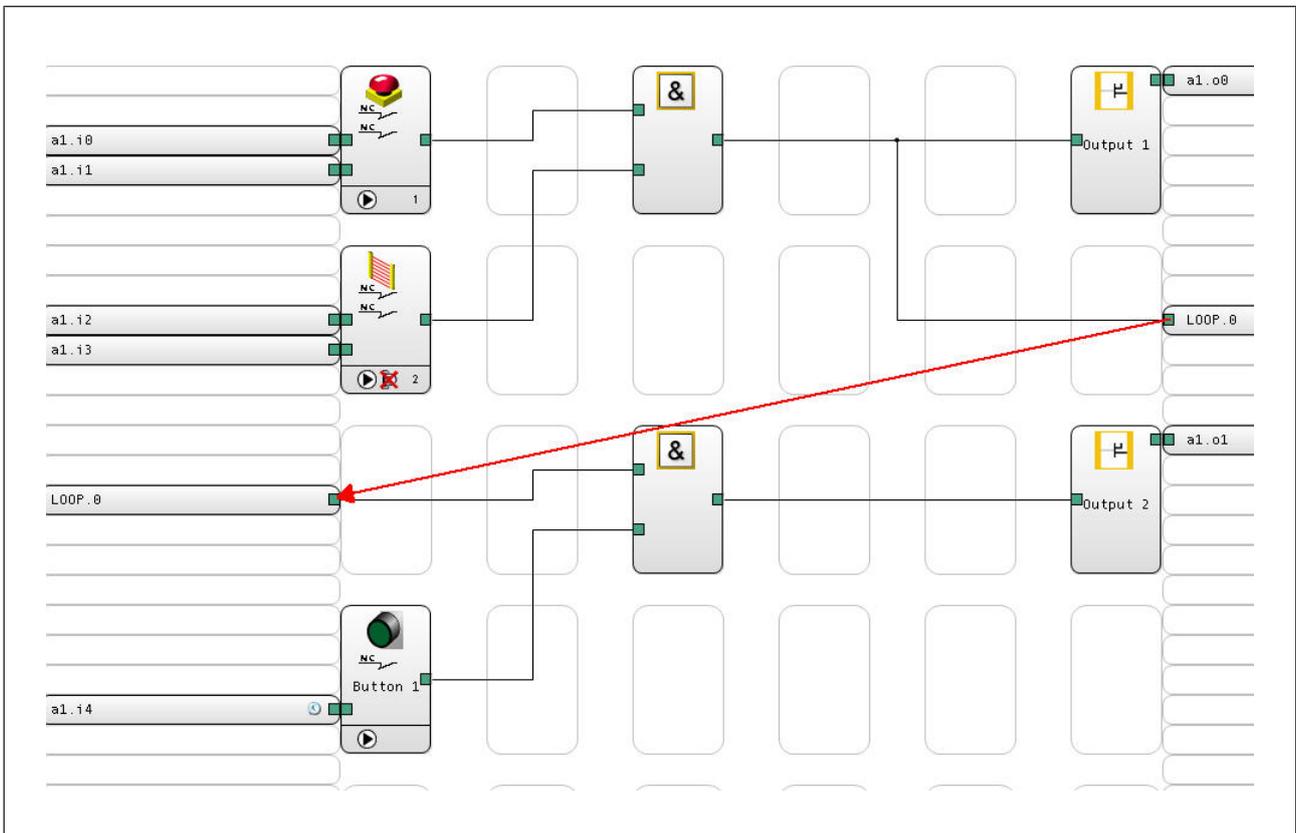


Calculating the switch-off delay of semiconductor output "Output 2" (a1.o1) when the E-STOP pushbutton is operated (a1.i0/a1.i1)

System's cycle time	15 ms
Switch-off delay of semiconductor output	30 ms
Number of loops	1
Switch-off delay of Output 2	
= (Number of loops * Cycle) + Switch-off delay of semiconductor output	
= (1*15 ms) + 30 ms	
= 45 ms	

5.3.2 Application using two loops

In the example configuration, the status of the "LOOP 0" output is made available one cycle later at the "LOOP 0" input. Logically, the "Output 2" output switches one cycle later than the "Output1" output.

One more cycle later, the status of output "LOOP1" is made available at the "LOOP1" input. This means that the "Output 3" output switches 2 cycles later than the "Output1" output.

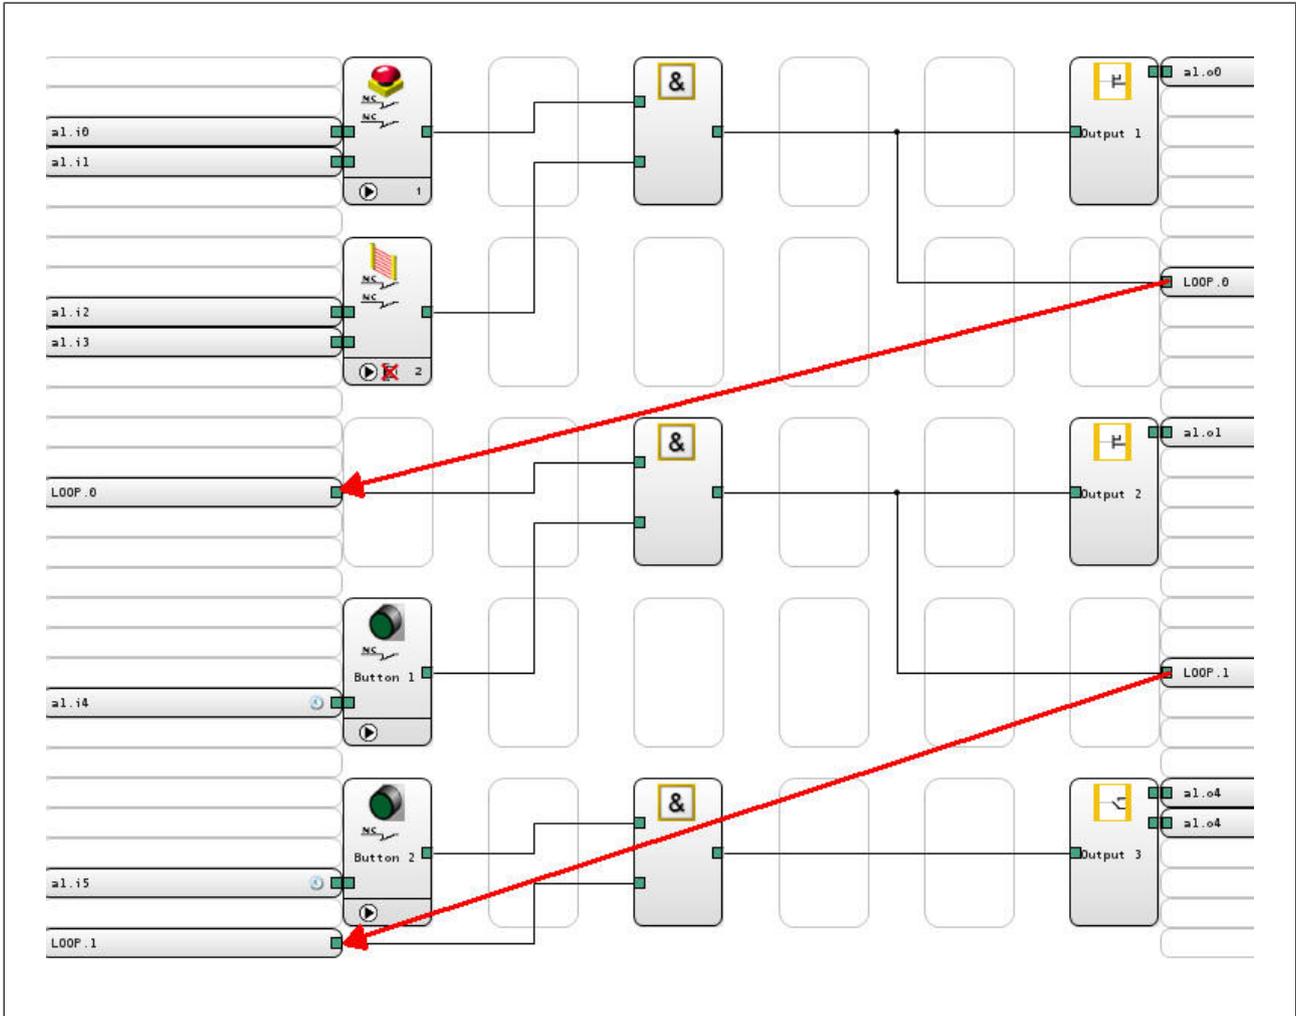

Calculating the switch-off delay of relay output "Output 3" (a1.o4/a1.o4) when the E-STOP pushbutton is operated (a1.i0/a1.i1)

System's cycle time	15 ms
Switch-off delay of relay output	50 ms
Number of loops	2
Switch-off delay of Output 3	
= (Number of loops * Cycle) + Switch-off delay of relay output	
= (2*15 ms) + 50 ms	
= 80 ms	

► Support

Technical support is available from Pilz round the clock.

Americas

Brazil
+55 11 97569-2804

Canada
+1 888 315 7459

Mexico
+52 55 5572 1300

USA (toll-free)
+1 877-PILZUSA (745-9872)

Asia

China
+86 21 60880878-216

Japan
+81 45 471-2281

South Korea
+82 31 778 3300

Australia

+61 3 95600621

Europe

Austria
+43 1 7986263-0

Belgium, Luxembourg
+32 9 3217570

France
+33 3 88104003

Germany
+49 711 3409-444

Ireland
+353 21 4804983

Italy, Malta
+39 0362 1826711

Scandinavia

+45 74436332

Spain

+34 938497433

Switzerland

+41 62 88979-32

The Netherlands

+31 347 320477

Turkey

+90 216 5775552

United Kingdom

+44 1536 462203

You can reach our international hotline on:

+49 711 3409-444
support@pilz.com

Pilz develops environmentally-friendly products using ecological materials and energy-saving technologies. Offices and production facilities are ecologically designed, environmentally-aware and energy-saving. So Pilz offers sustainability, plus the security of using energy-efficient products and environmentally-friendly solutions.



We are represented internationally. Please refer to our homepage www.pilz.com for further details or contact our headquarters.

Headquarters: Pilz GmbH & Co. KG, Felix-Wankel-Straße 2, 73760 Ostfildern, Germany
Telephone: +49 711 3409-0, Telefax: +49 711 3409-133, E-Mail: info@pilz.com, Internet: www.pilz.com

PILZ
THE SPIRIT OF SAFETY

1002337-EN-04, 2020-03 Printed in Germany
© Pilz GmbH & Co. KG, 2019

CECC® , CHRE® , CMSE® , InduraNET p® , Leansafe® , Master of Safety® , Master of Security® , PAS4000® , PAScall® , PASconfig® , Pilz® , PTT® , PLID® , PMCPirimo® , PMCPiritego® , PMCTendo® , PMD® , PMJ® , PNOZ® , PRBT® , PRCM® , PRCM® , PSEN® , PSS® , PVS® , SafetyBUS p® , SafetyNET p® , THE SPIRIT OF SAFETY® are registered and protected trademarks of Pilz GmbH & Co. KG in some countries. We would point out that product features may vary from the details stated in this document, depending on the status at the time of publication and the scope of the equipment. We accept no responsibility for the validity, accuracy and entirety of the text and graphics presented in this information. Please contact our Technical Support if you have any questions.